

See for similar files: <http://www.ps.bam.de/KE95/KE95.HTM>  
Information and Order: <http://www.ps.bam.de> Version 2.0, io=5,5

BAM registration: 20030101-KE95/10A/A95E04NP.PS/.PDF  
application for monitors  
BAM material: code=rha4ta

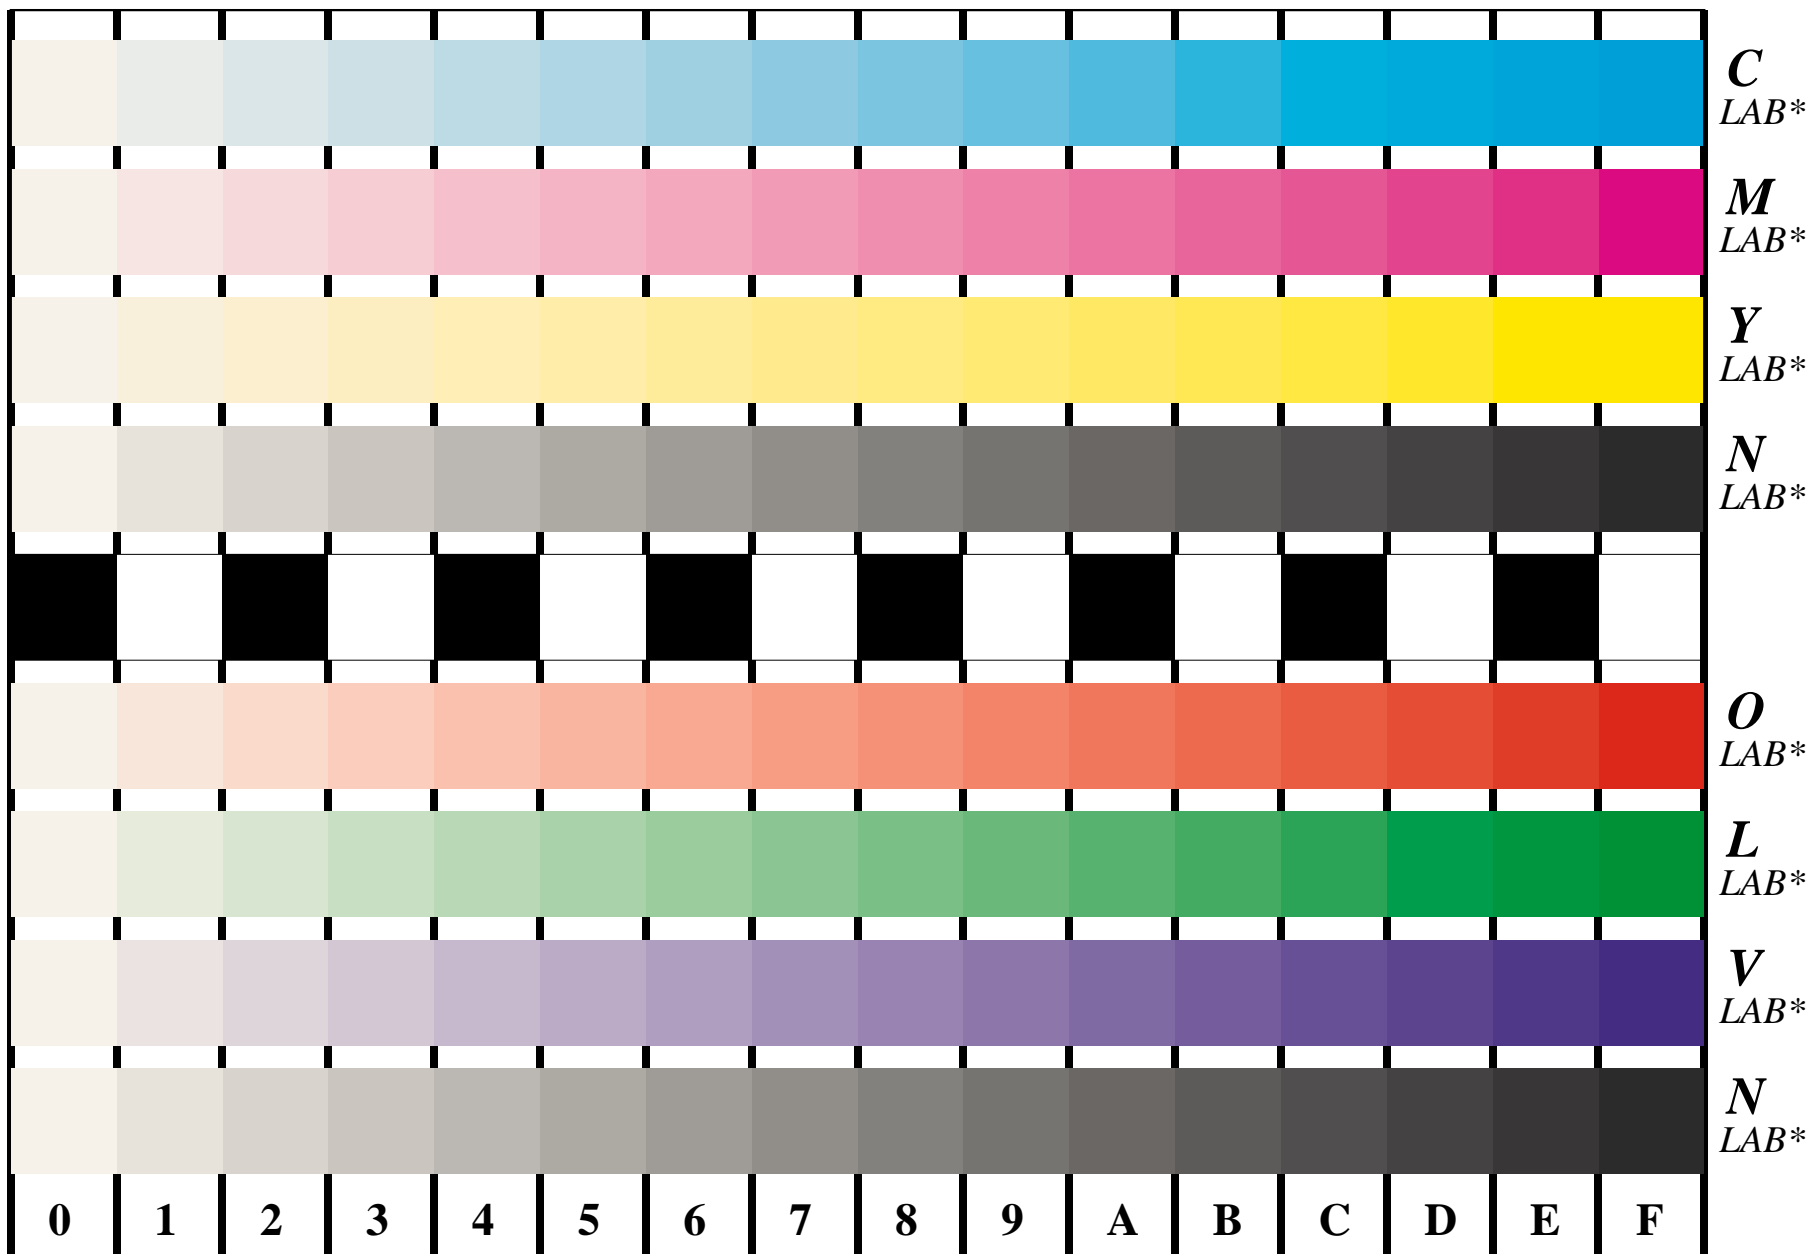


Figure B4 and D4 of the ISO/IEC-test charts no. 2 and 4; 16 visual equidistant steps of colour series; Use of the PS operator  $LAB^*_{setcolor}$





Fig. B4/D4 of ISO/IEC-test chart 2/4;

ISO/IEC 15775 and  
TR ISO/IEC 24705;

input:  $LAB^*_{setcolor}$   
output: no change compared to input

C

M

Y

O

L

V

C