

See for similar files: <http://www.ps.bam.de/KE95/KE95.HTM>  
Information and Order: <http://www.ps.bam.de> Version 2.0, io=5,6; iOLS; oOLS, CIEXYZ

BAM registration: 20030101-KE95/10C/C95E06FP.PS/.PDF BAM material: code=rha4ta  
application for monitors, Yr=5.0, XYZ

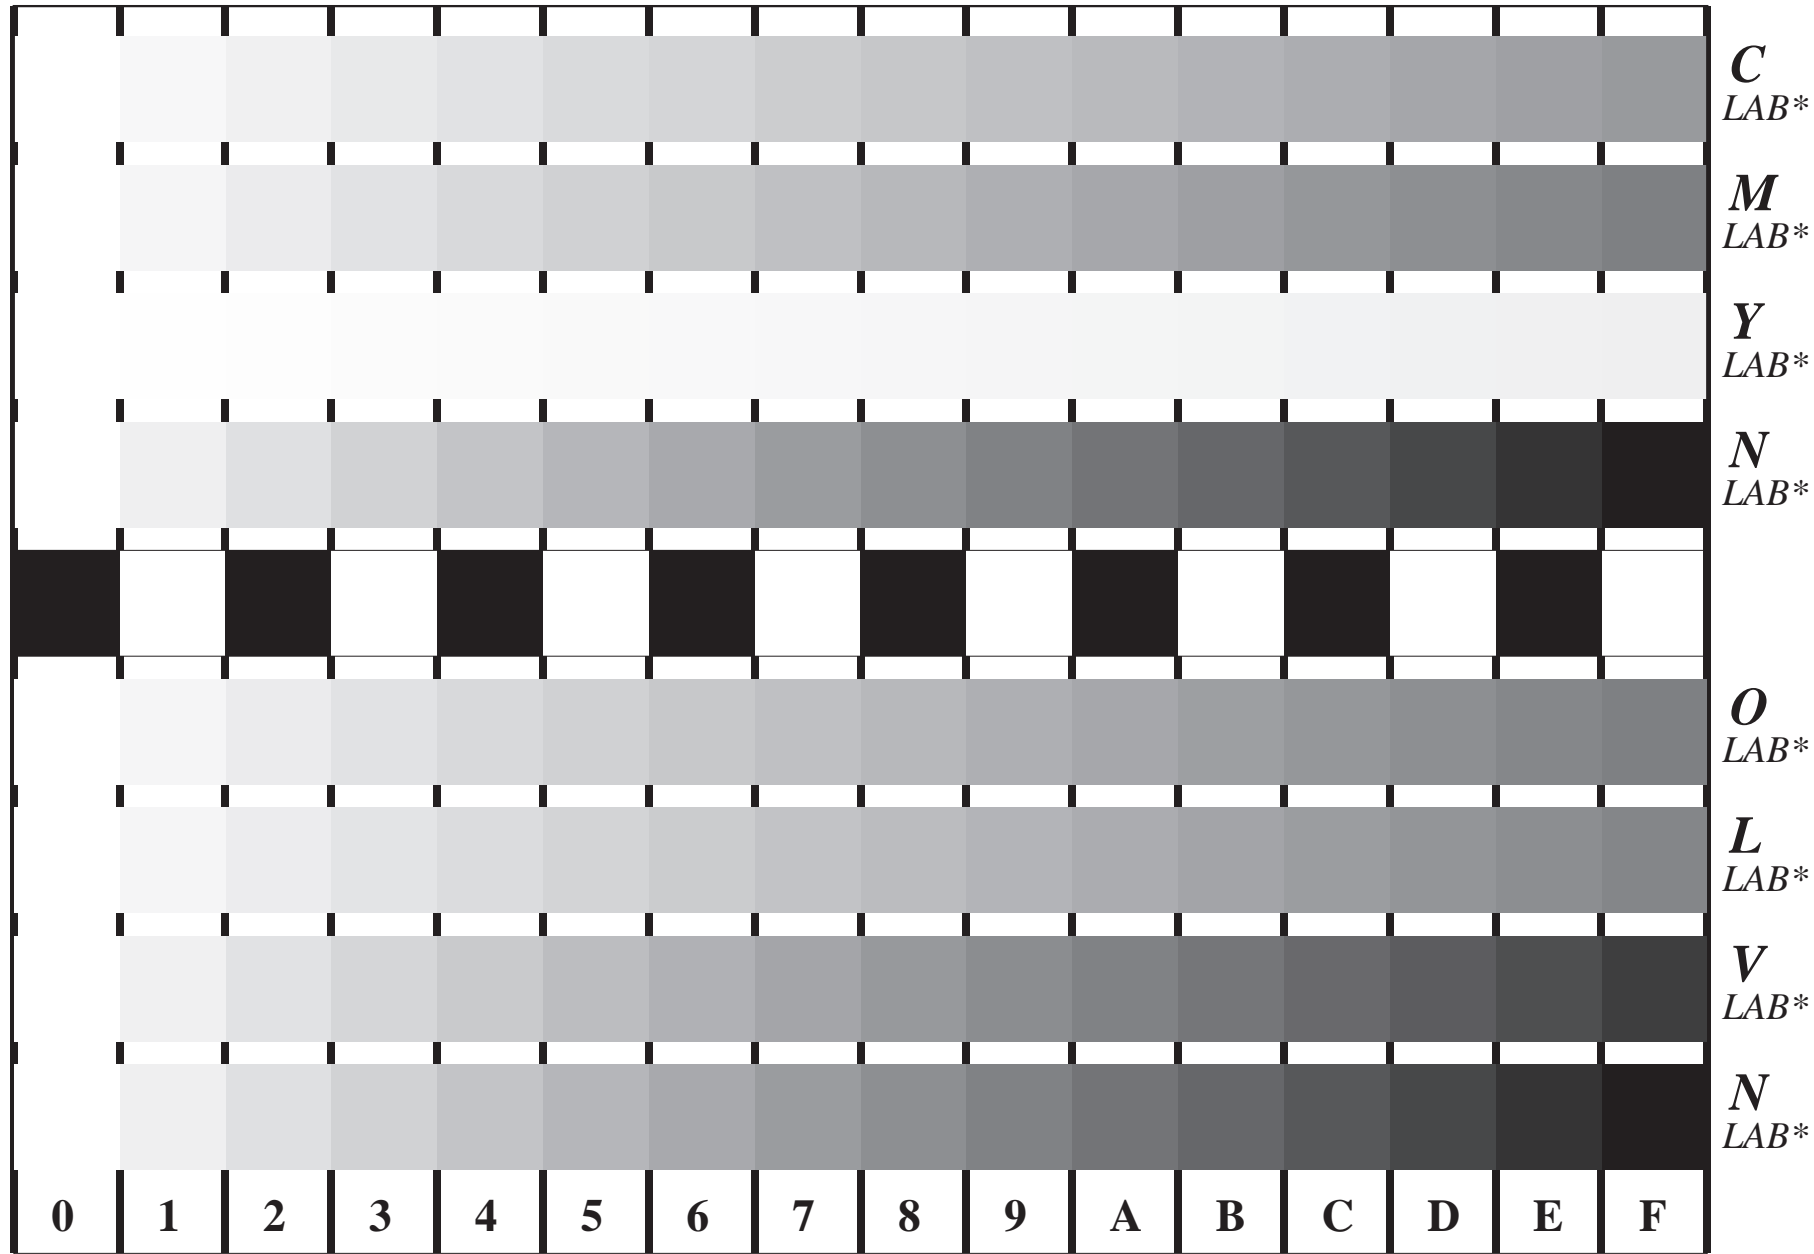


Figure B4 and D4 of the ISO/IEC-test charts no. 2 and 4; 16 visual equidistant steps of colour series; Use of the PS operator  $LAB^*_{setcolor}$

Fig. B4/D4 of ISO/IEC-test chart 2/4;

ISO/IEC 15775 and  
TR ISO/IEC 24705;

input:  $LAB^*_{setcolor}$   
output:  $000n^*_{setcmykcolor}$

