



LE450-3, Transfer to device independent LAB*/LCH* data; output via the Natural Colour Connection Space *tab*/tch**

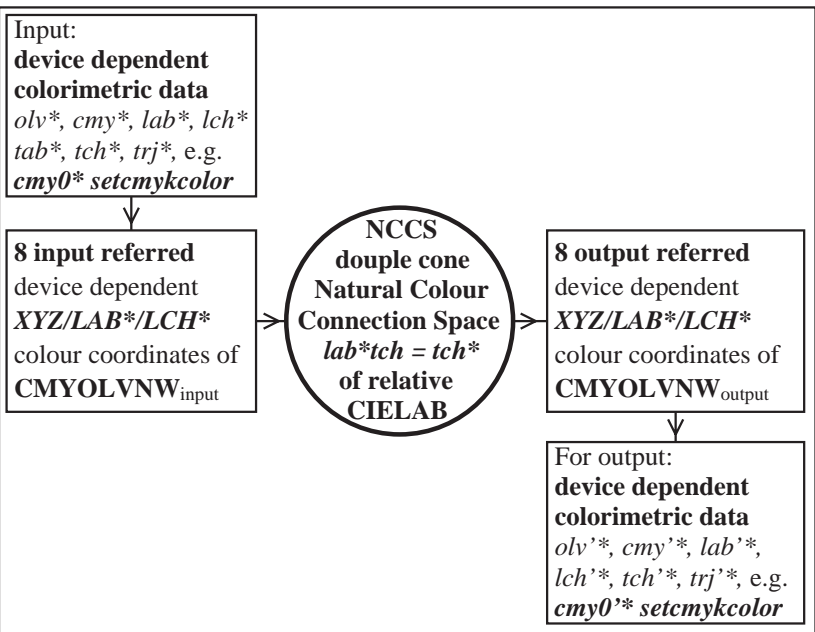

LE450-7, Transfer from device dependent *cmv0** data; output via NCCS with new *cmv0** data

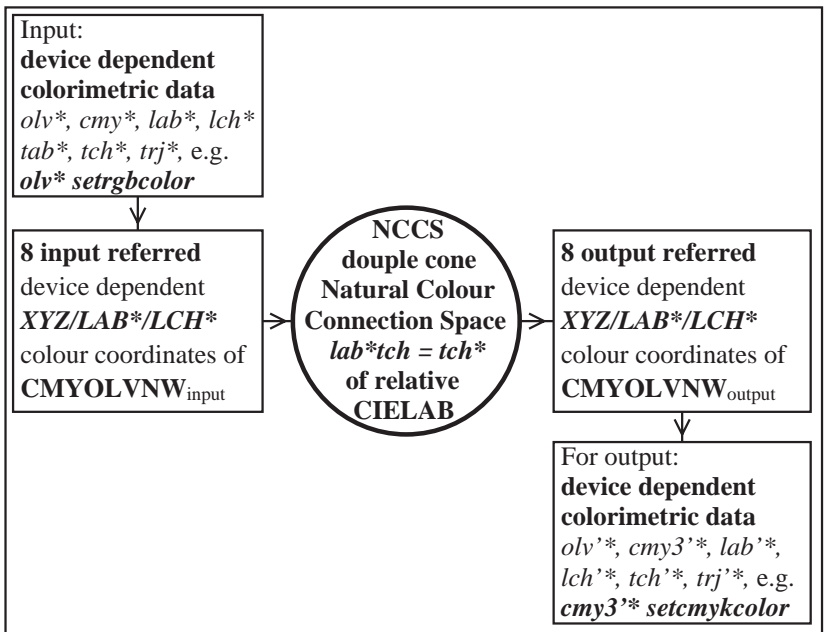

LE451-7, Transfer from device dependent *olv** data; output via NCCS with *cmv0** data

BAM-test chart no. LE45; colour transfer and workflow
 Connection: input and output referred colour spaces

input: *cmv0** *setcmkcolor*
 output: no change compared to input

See for similar files: <http://www.ps.bam.de/LE45/>
 Technical information: <http://www.ps.bam.de>
 Version 2.1, io=1,1

BAM registration: 20050501-LE45/10L/L45E00NA.PS/.TXT
 application for measurement of printer or monitor systems

LE45/ Form: 1/2, Serie: 1/1, Page: 1
 Page count: 1
 BAM material: code=rh4ta