http://farbe.li.tu-berlin.de/AET4/AET4L0N1.TXT /.PS; only vector graphic VG; start output
N: no 3D-linearization (OL) in file (F) or PS-startup (S)

see similar files: http://farbe.li.tu-berlin.de/AET4/AET4.HTM
technical information: http://farbe.li.tu-berlin.de or http://130.149.60.45/~farbmetrik

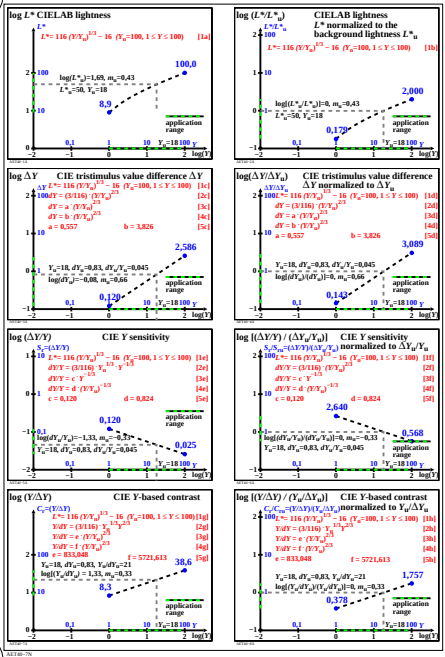

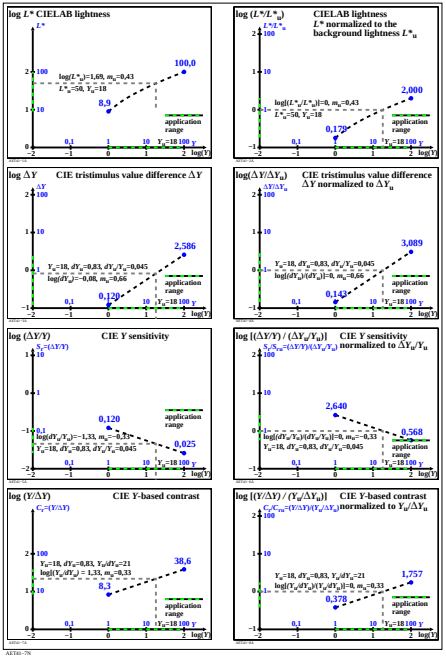

TUB registration: 20201101-AET4/AET4L0N1.TXT /.PS
application for evaluation and measurement of display or print output

TUB material: code=rha4ta

TUB-test chart AET4; For CIELAB colour-difference formula, see ISO/CIE input: 4-gb/cmy0/000k/n change of gamma g_P
log[lightness L^*, threshold ΔY, sensitivity $\Delta Y / Y$, contrast $Y / \Delta Y$], unnormalized and normalized