



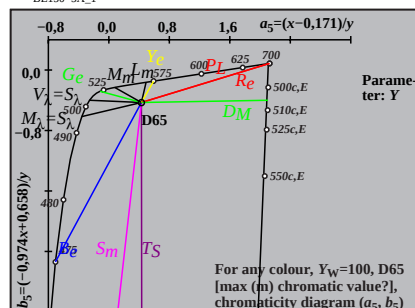



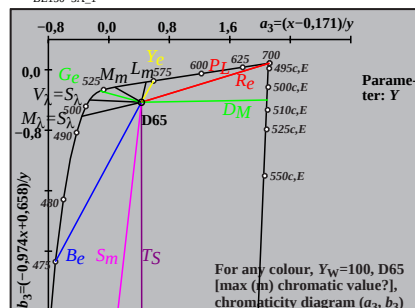
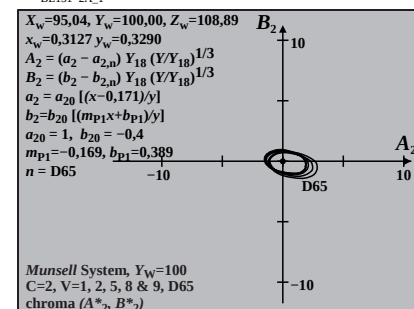


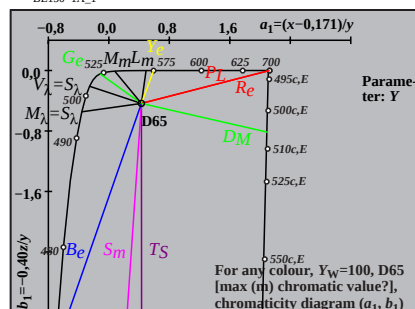





see similar files: <http://farbe.li.tu-berlin.de/BE15/BE15.HTM>
technical information: <http://farbe.li.tu-berlin.de> or <http://130.149.60.45/~farbmeterik>

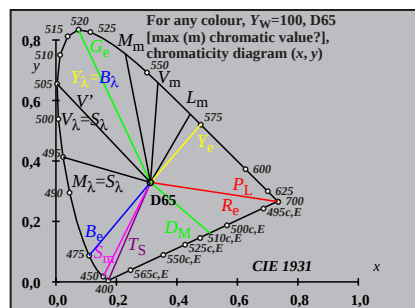

TUB-test chart BE15; CIE (x, y) and chroma (A*, B*)

Munsell Chroma=2, Value=1,2,5,8 & 9 for CIE illuminant C; diagram for illuminant D65, Yw=100

input: w/rgb/cmyk -> rgb

















TUB registration: 20170801-BE15/BE15L0NP.PDF /.PS
application for measurement of offset print output

TUB material: code=rha4ta

see similar files: <http://farbe.li.tu-berlin.de/BE15/BE15.HTM>
technical information: <http://farbe.li.tu-berlin.de> or <http://130.149.60.45/~farbmeterik>

TUB registration: 20170801-BE15/BE15L0NP.PDF /.PS
application for measurement of offset print output

TUB material: code=rha4ta









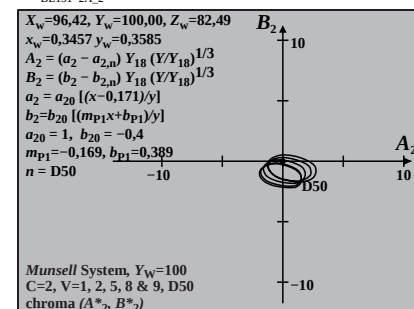









TUB-test chart BE15; CIE (x, y) and chroma (A^*_i, B^*_i)

Munsell Chroma=2, Value=1,2,5,8 & 9 for CIE illuminant C; diagram for illuminant D50, $Y_w=100$

input: w/rgb/cmyk -> rgb

see similar files: <http://farbe.li.tu-berlin.de/BE15/BE15.HTM>
technical information: <http://farbe.li.tu-berlin.de> or <http://130.149.60.45/~farbmeterik>

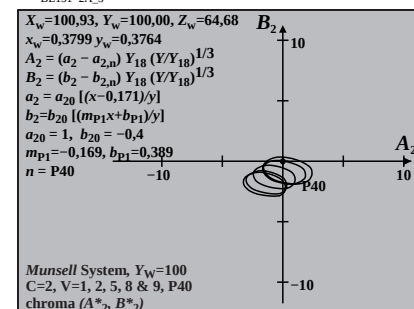

TUB-test chart BE15; CIE (x, y) and chroma (A^*_i, B^*_i)


Munsell Chroma=2, Value=1,2,5,8 & 9 for CIE illuminant C; diagram for illuminant P40, $Y_w=100$

input: w/rgb/cmyk -> rgb

TUB registration: 20170801-BE15/BE15L0NP.PDF /.PS
application for measurement of offset print output

TUB material: code=rha4ta

TUB material: code=rha4ta

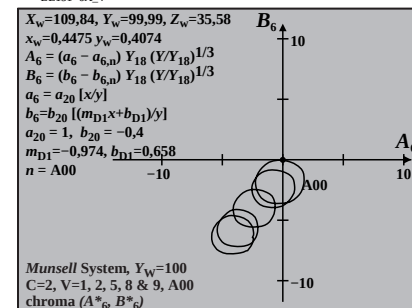



















N: no 3D-linearization (OL) in file (F) or PS-startup (S), page 6/8

see similar files: <http://farbe.li.tu-berlin.de/BE15/BE15.HTM>
technical information: <http://farbe.li.tu-berlin.de> or <http://130.149.60.45/~farbmetrik>

TUB registration: 20170801-BE15/BE15L0NP.PID
application for measurement of offset print output

TUB material: code=rh4ta

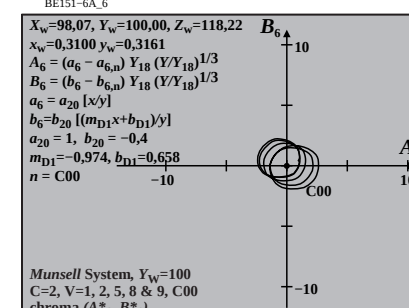
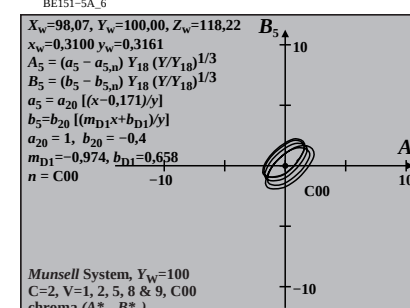
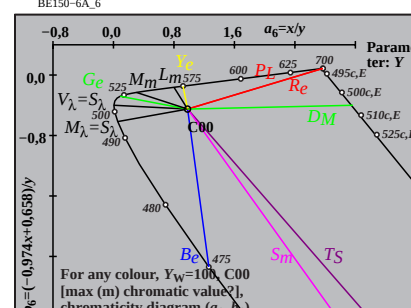

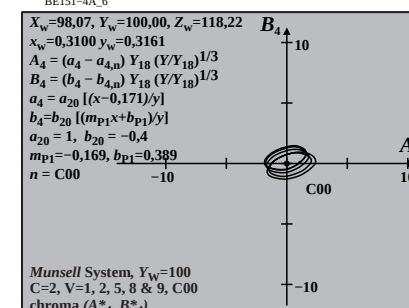
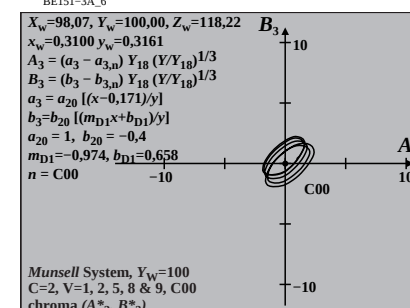
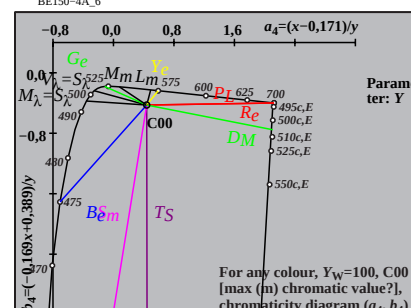

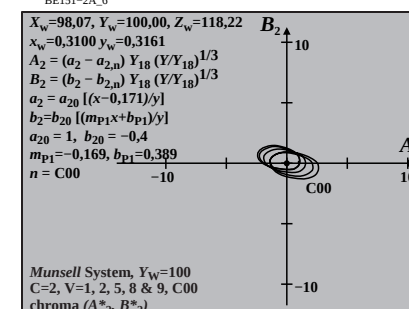
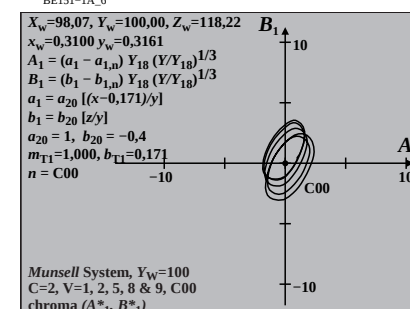
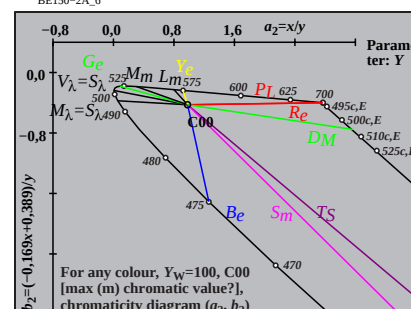

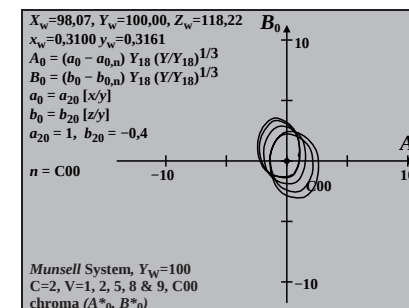
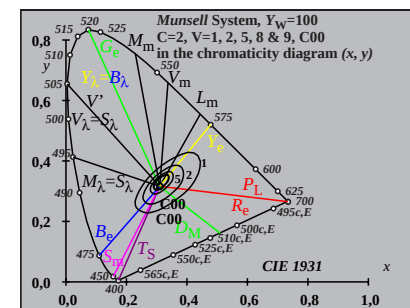
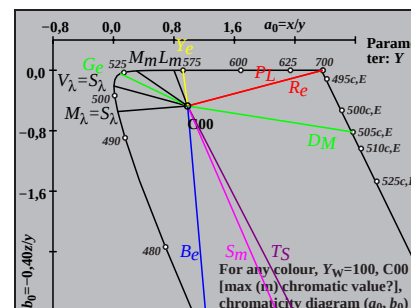

TUB-test chart BE15; CIE (x, y) and chroma (A^*_i, B^*_i)

Munsell Chroma=2, Value=1,2,5,8 &9 for CIE illuminant C; diagram for illuminant C00, $Y_w=100$

input: w/r**gb**/cmyk $\rightarrow$ r**gb**

n for illuminant C00, $Y_w=100$

see similar files: <http://farbe.li-tu-berlin.de/BE15/BE15.HTM>
technical information: <http://farbe.li-tu-berlin.de> or <http://130.149.60.45/~farbmeterik>

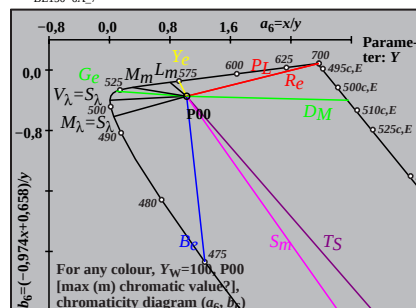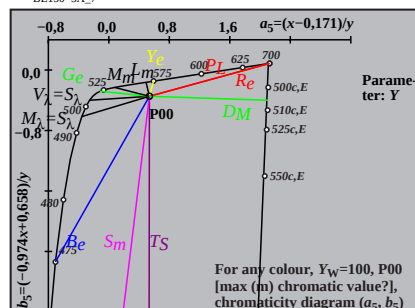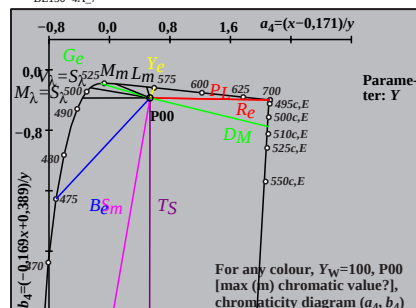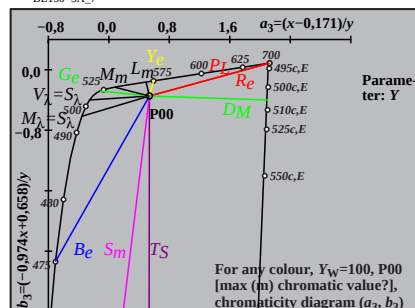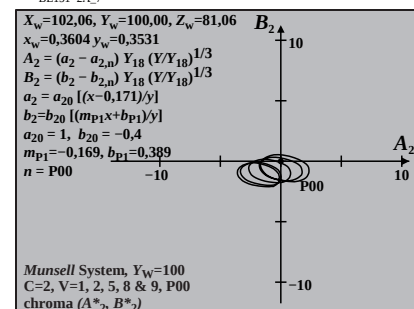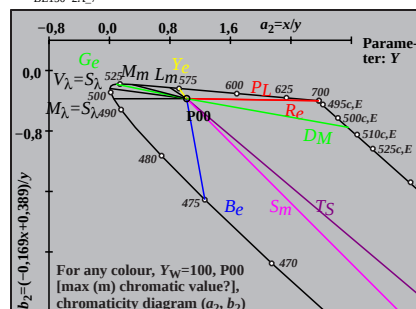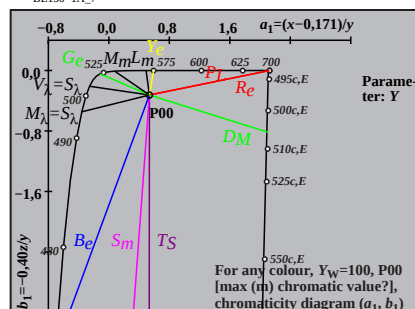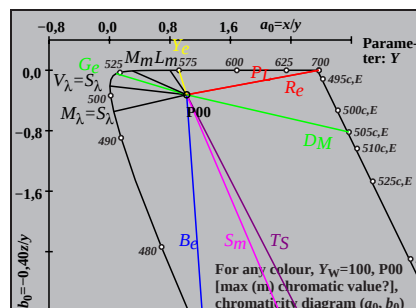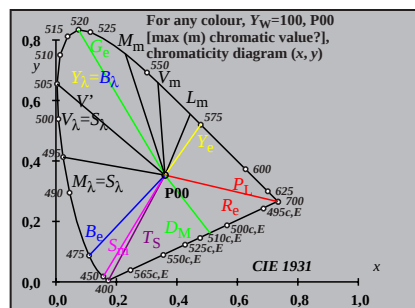

TUB-test chart BE15; CIE (x, y) and chroma (A^*_i, B^*_i)

















Munsell Chroma=2, Value=1,2,5,8 & 9 for CIE illuminant C; diagram for illuminant P00, $Y_w=100$

input: w/rgb/cmyk -> rgb

TUB registration: 20170801-BE15/BE15L0NP.PDF /.PS
application for measurement of offset print output

TUB material: code=rha4ta

see similar files: <http://farbe.li.tu-berlin.de/BE15/BE15.HTM>
technical information: <http://farbe.li.tu-berlin.de> or <http://130.149.60.45/~farbmeterik>

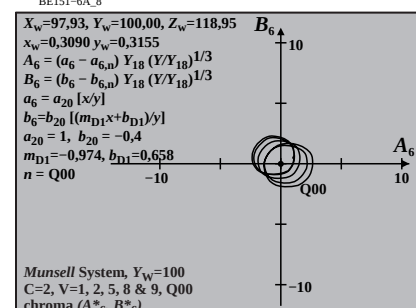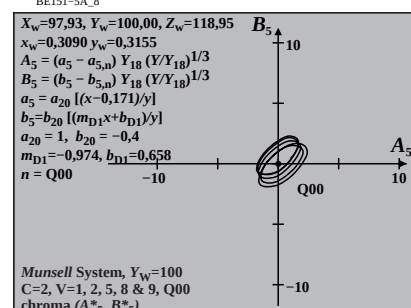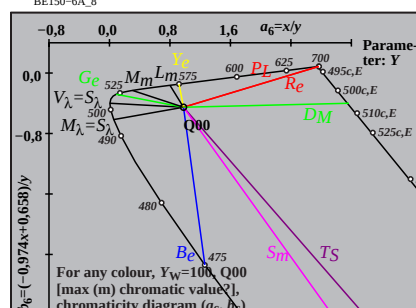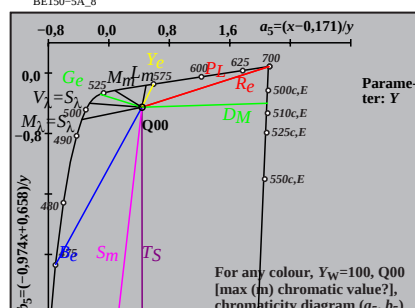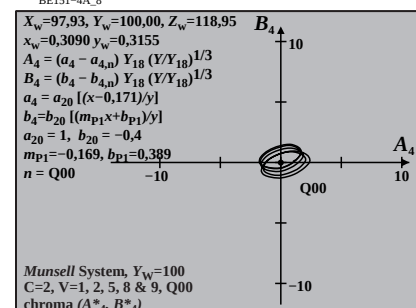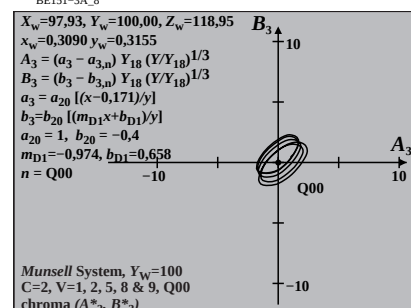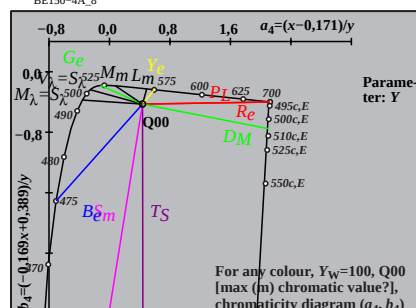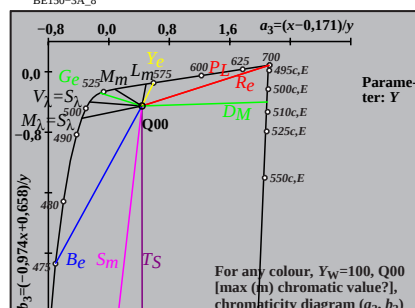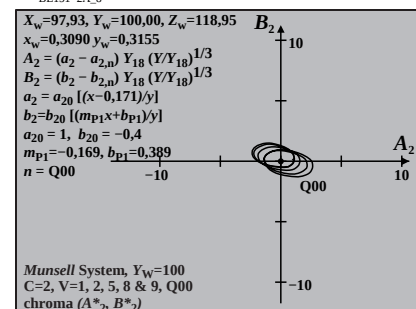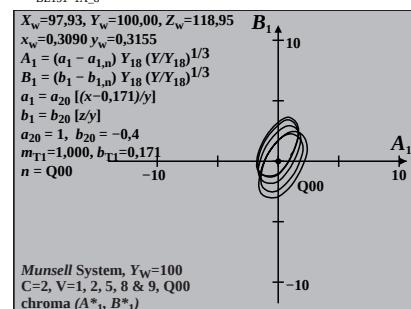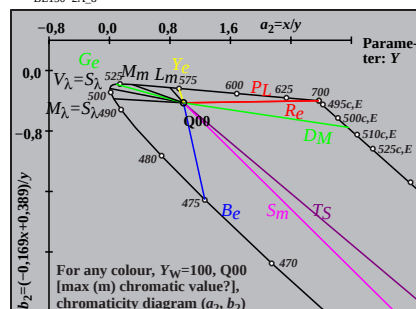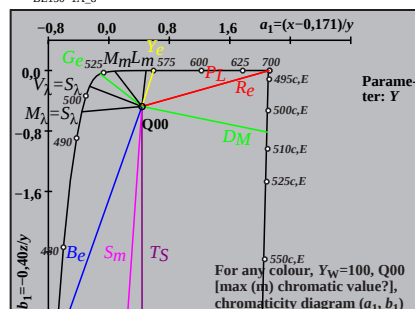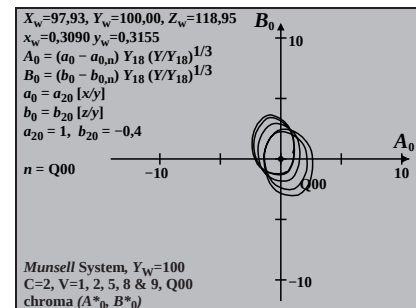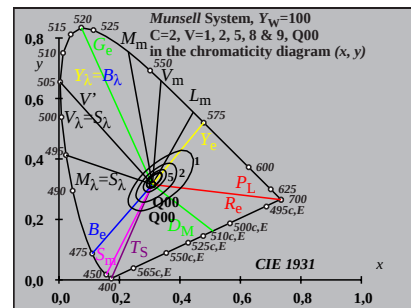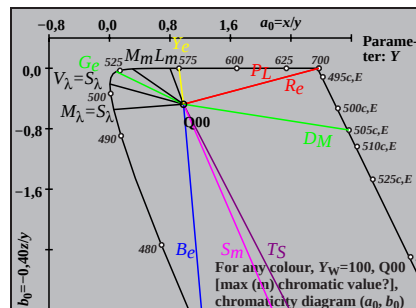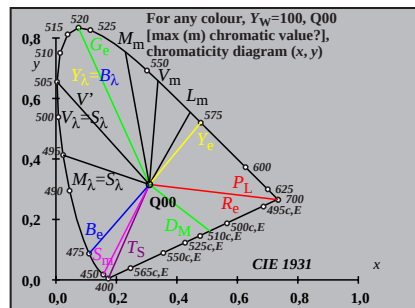

TUB-test chart BE15; CIE (x, y) and chroma (A^*_i, B^*_i)

Munsell Chroma=2, Value=1,2,5,8 & 9 for CIE illuminant C; diagram for illuminant Q00, $Y_w=100$

input: w/rgb/cmyk -> rgb

TUB registration: 20170801-BE15/BE15L0NP.PDF /.PS
application for measurement of offset print output

TUB material: code=rha4ta