
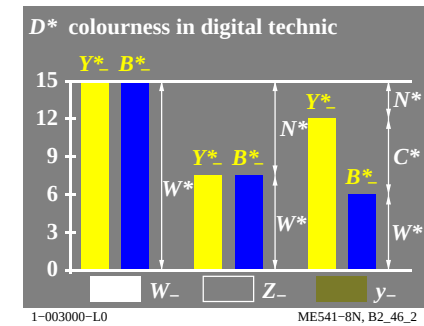
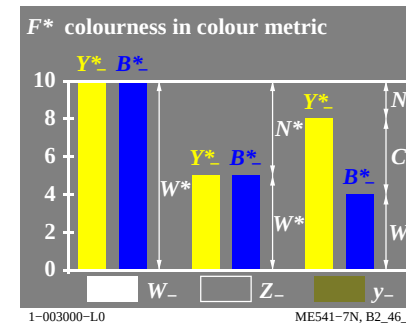
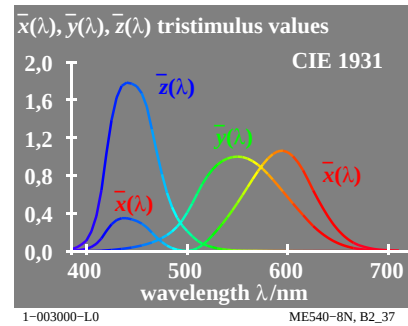
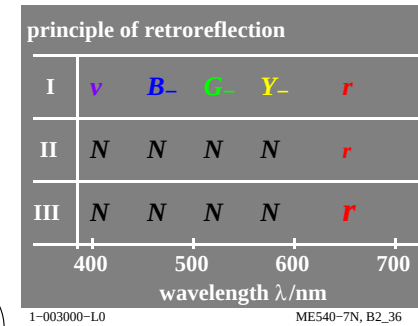
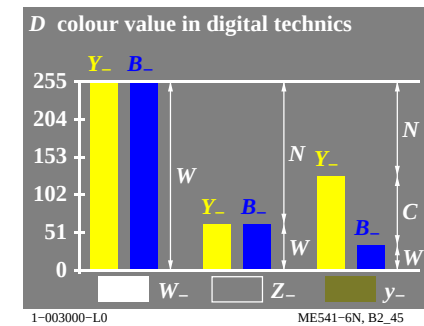
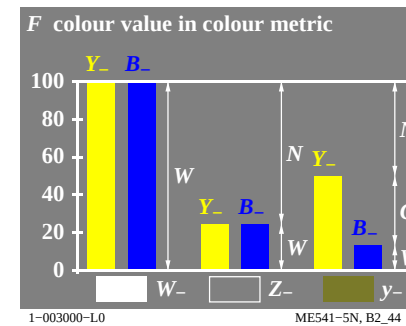
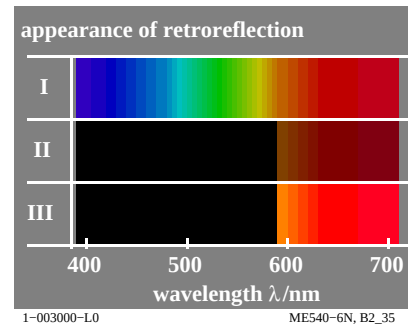
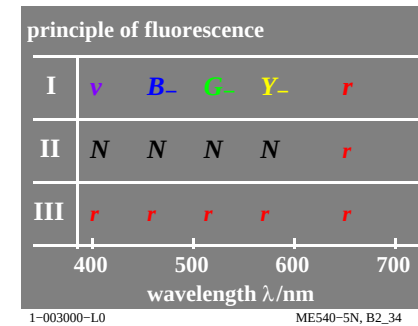
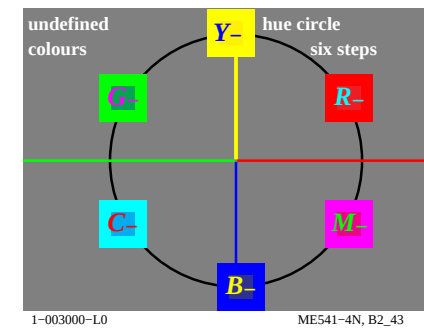
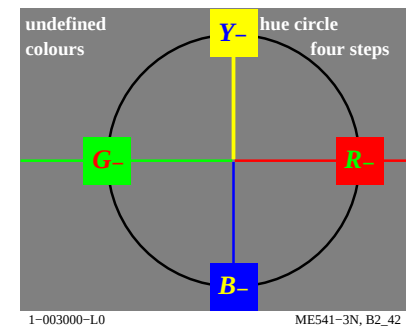
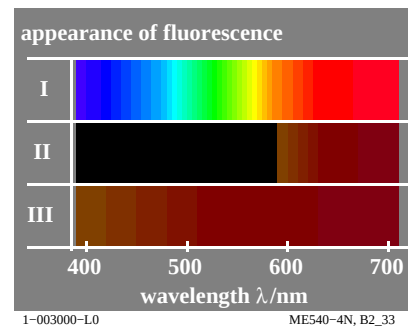
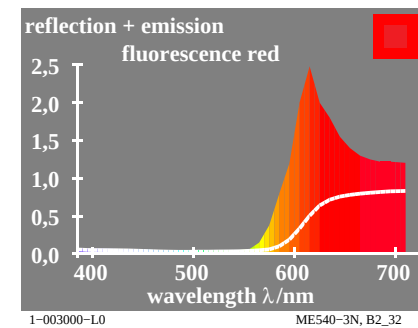
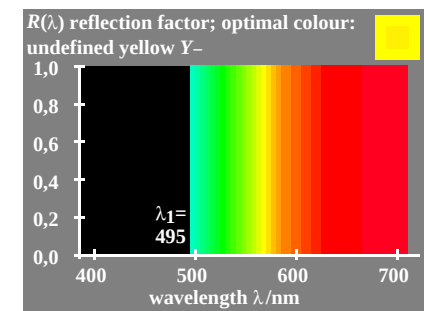
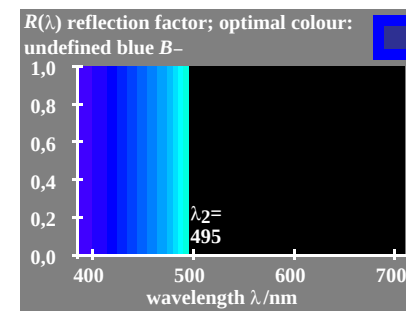
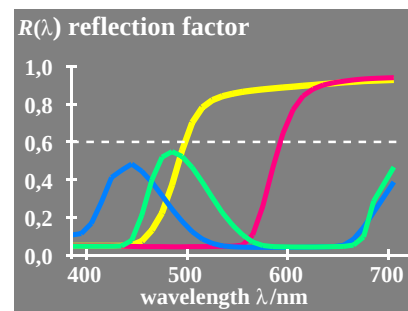


<http://farbe.li.tu-berlin.de/ME54/ME54L0NA.TXT> /PS; start output
N: no 3D-linearization (OL) in file (F) or PS-startup (S), page 1/2

see similar files: <http://farbe.li.tu-berlin.de/ME54/ME54.HTM>
<http://130.149.60.45/~farbmeterik> or <http://farbe.li.tu-berlin.de>

















TUB registration: 20190801-ME54/ME54L0NA.TXT /PS
application for measurement of display output

TUB material: code=rha4ta

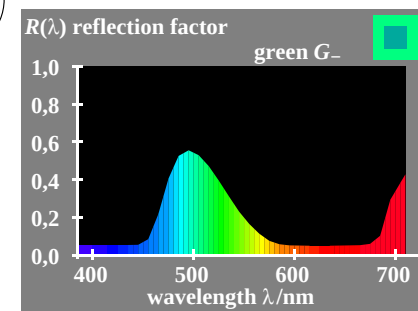

TUB-test chart ME54; Computer graphics and colorimetry
Image series ME54, 3D=0, de=0

input: rgb/cmyk $\rightarrow$ rgb/cmyk
output: no change

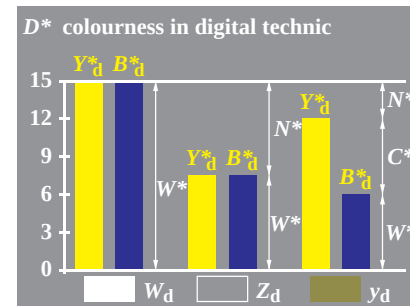
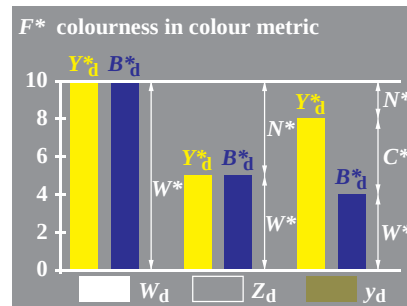
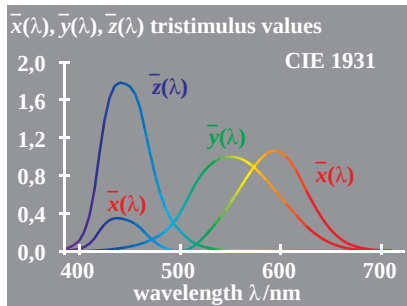
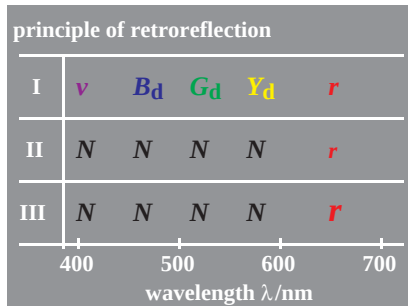
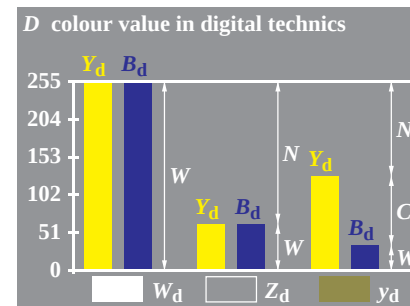
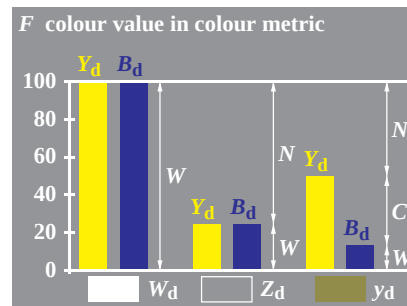
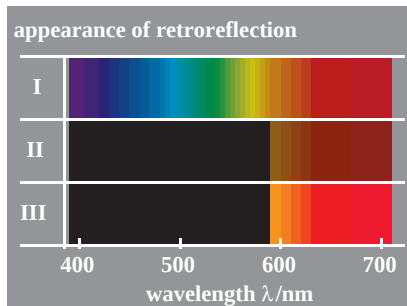
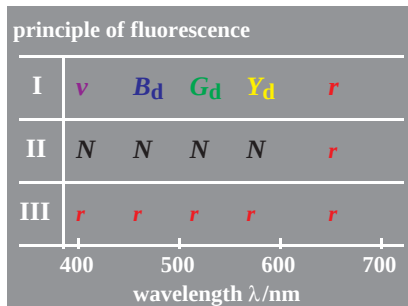
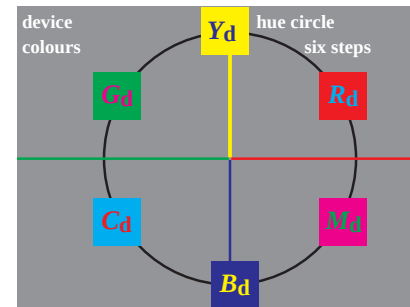
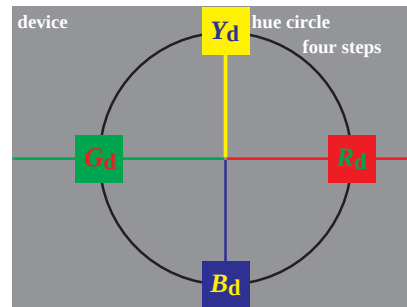
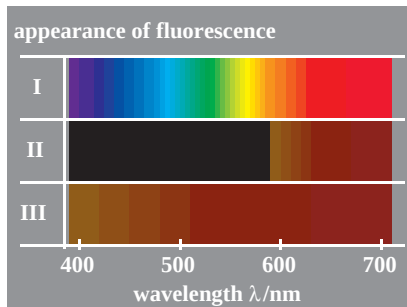
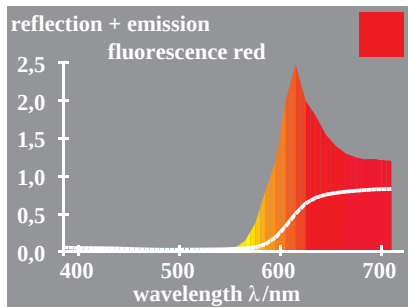
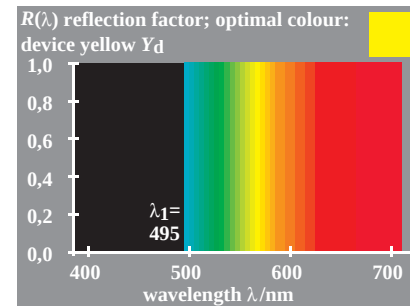
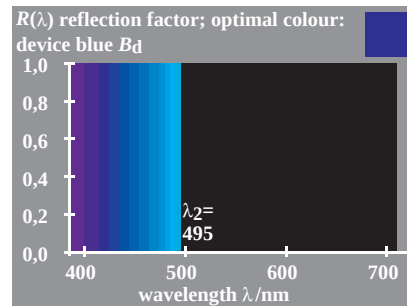
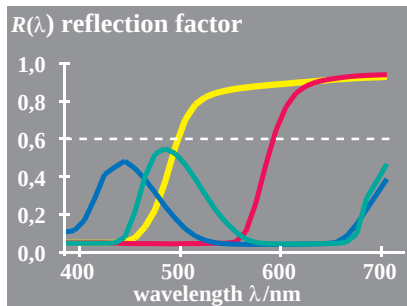
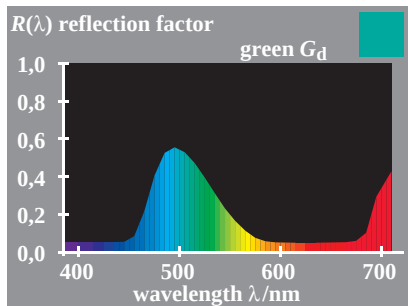


http://farbe.li.tu-berlin.de/ME54/ME54L0NA.TXT /.PS; start output
N: no 3D-linearization (OL) in file (F) or PS-startup (S), page 1/2

see similar files: <http://farbe.li.tu-berlin.de/ME54/ME54.HTM>
<http://130.149.60.45/~farbmeterik> or <http://farbe.li.tu-berlin.de>

TUB registration: 20190801-ME54/ME54L0NA.TXT /.PS
application for measurement of display output

TUB material: code=rha4ta

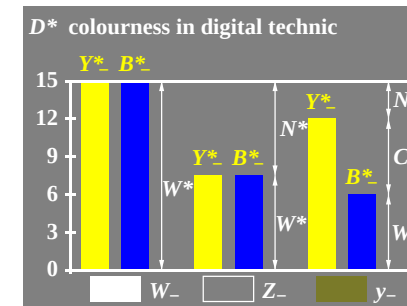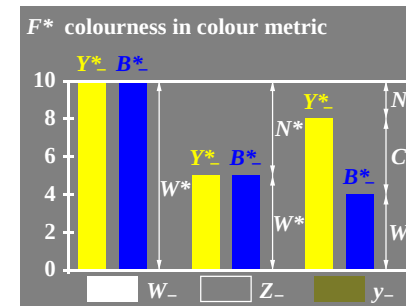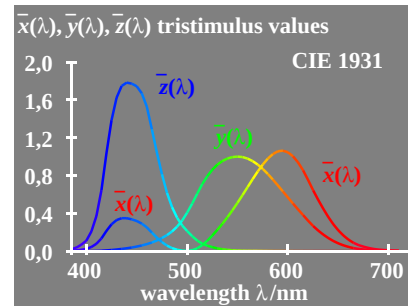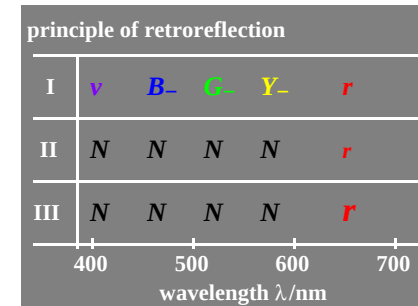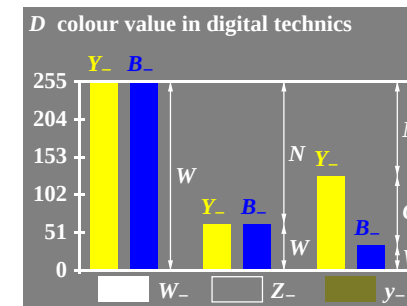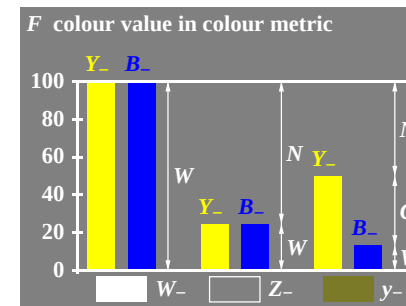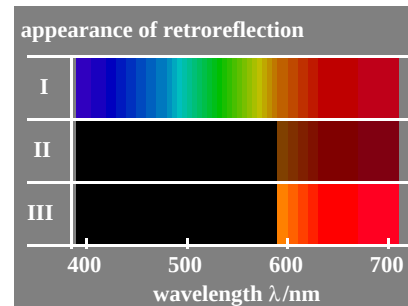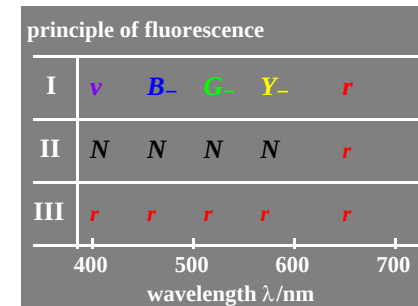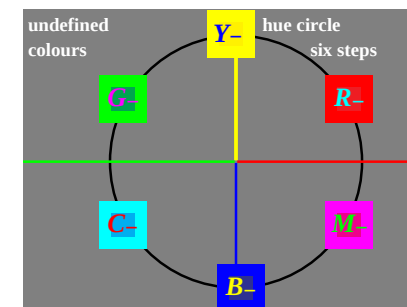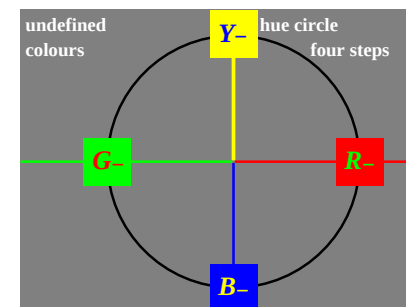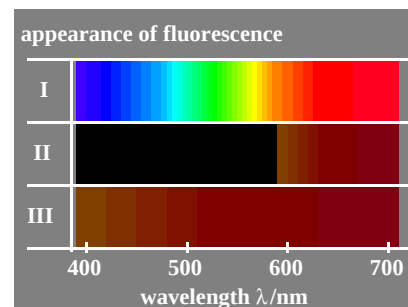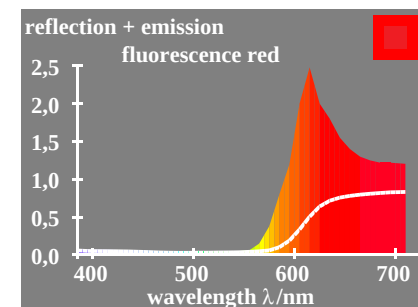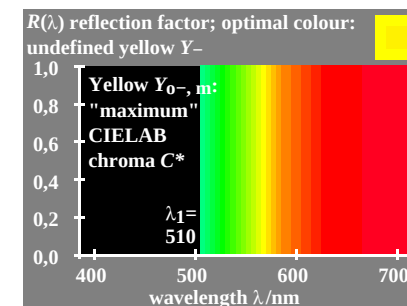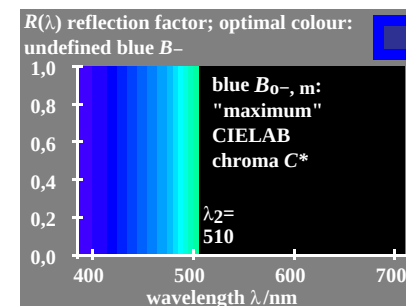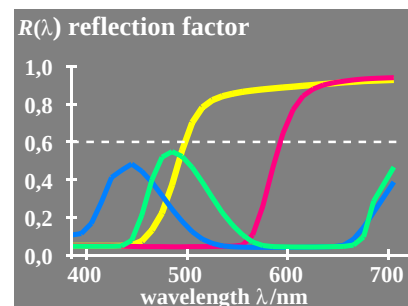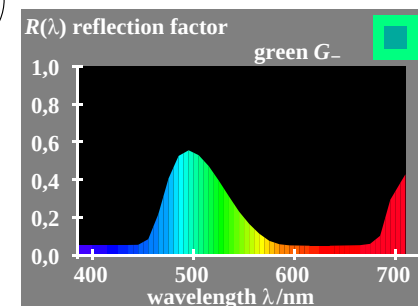

TUB-test chart ME54; Computer graphics and colorimetry
Image series ME54, 3D=0, de=1

input: rgb/cmyk $\rightarrow$ rgb/cmyk
output: no change

















<http://farbe.li.tu-berlin.de/ME54/ME54L0NA.TXT> /PS; transfer output

N: no 3D-linearization (OL) in file (F) or PS-startup (S), page 2/2

see similar files: <http://farbe.li.tu-berlin.de/ME54/ME54.HTM>
<http://130.149.60.45/~farbmeterik> or <http://farbe.li.tu-berlin.de>

TUB registration: 20190801-ME54/ME54L0NA.TXT /PS
 application for measurement of display output, no separation

TUB material: code=rha4ta

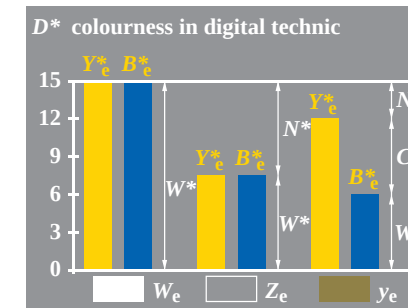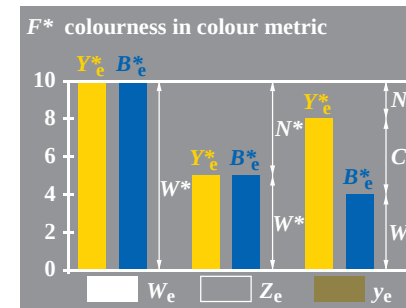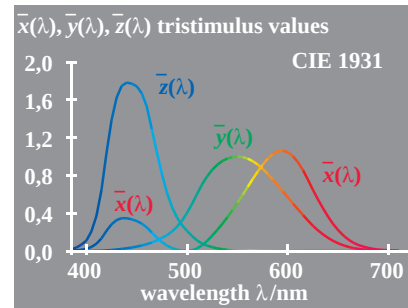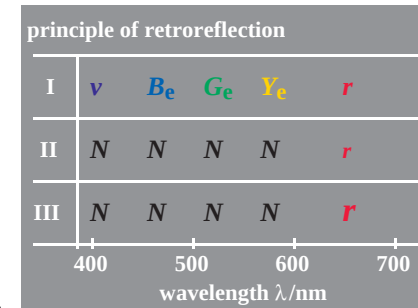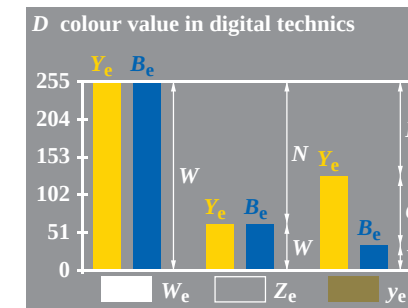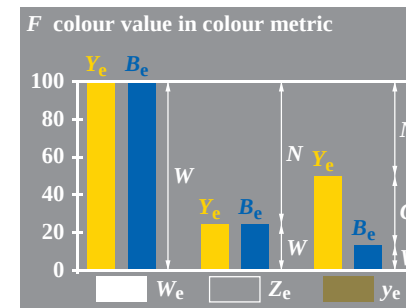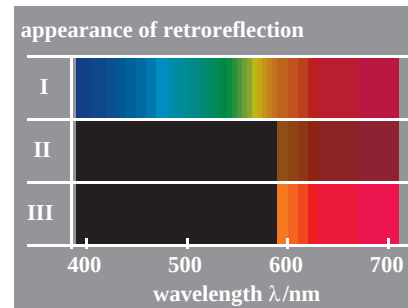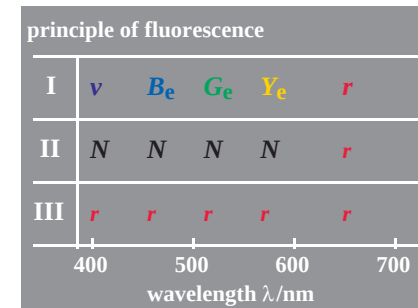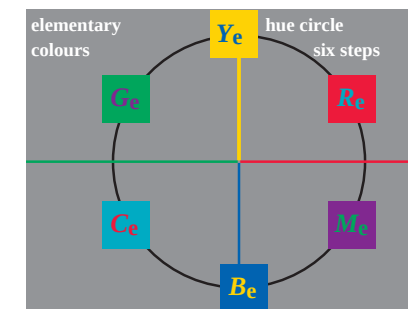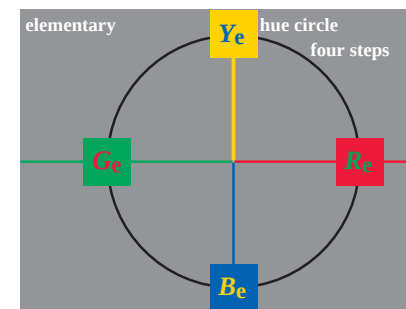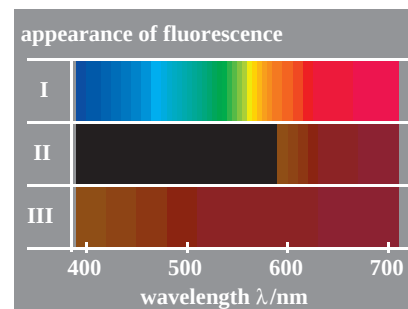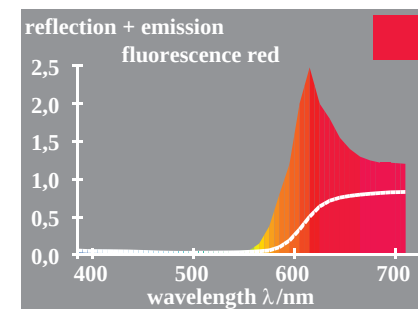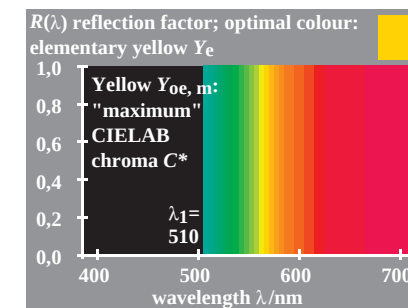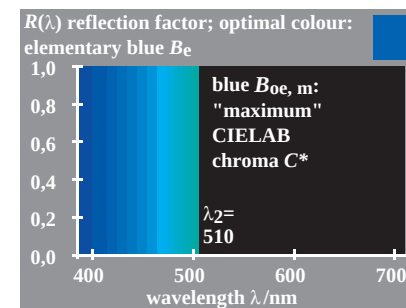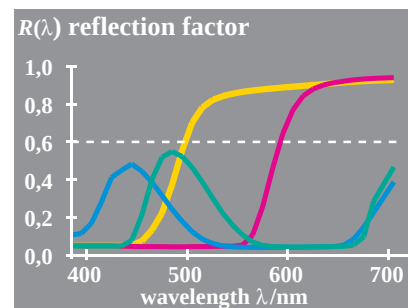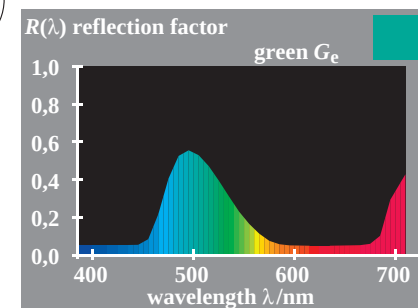

TUB-test chart ME54; Computer graphics and colorimetry
 Image series ME54, 3D=0, de=1, L^*cmyn6

PE4300L_120830.TXT, 1080 colors, Separation $cmyn6^*$
 input: $rgb/cmyk \rightarrow rgb_e$
 output: transfer to rgb_e

