
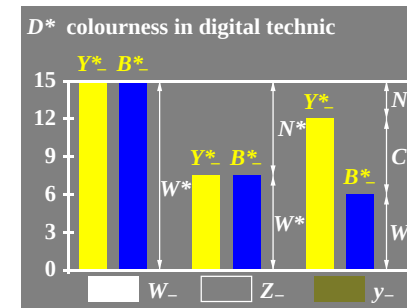
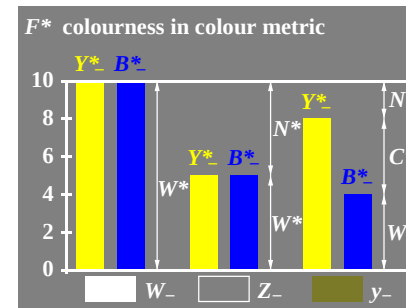
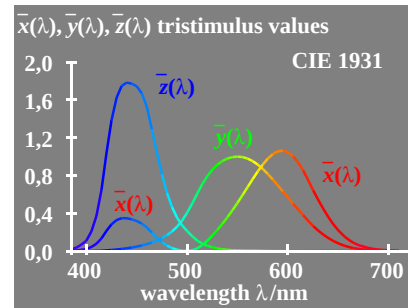
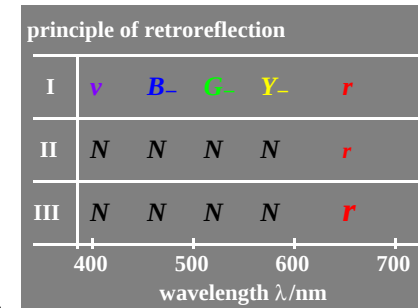
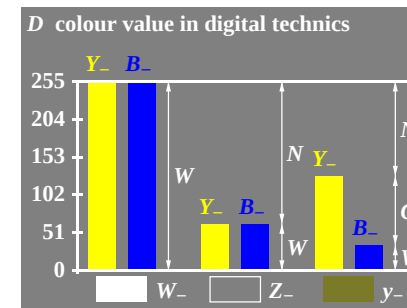
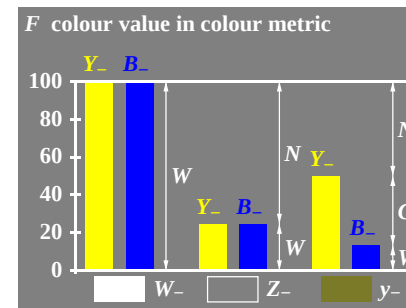
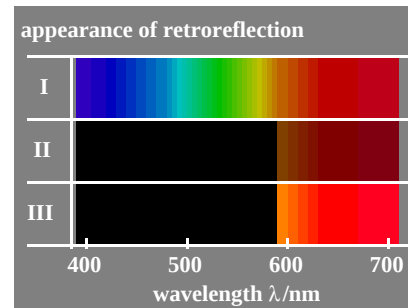
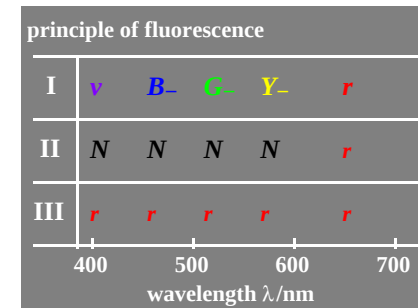
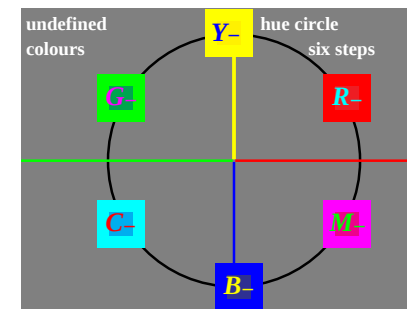
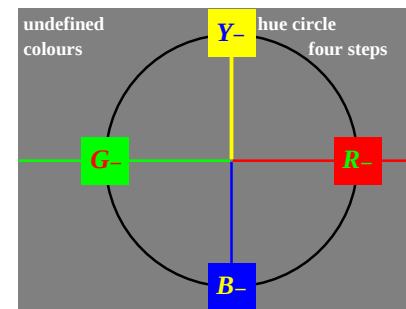
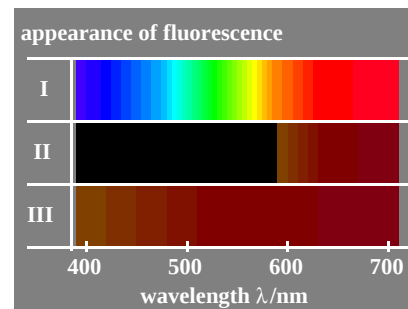
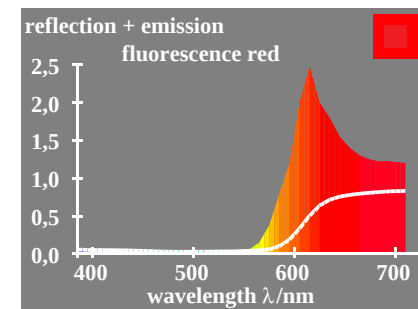
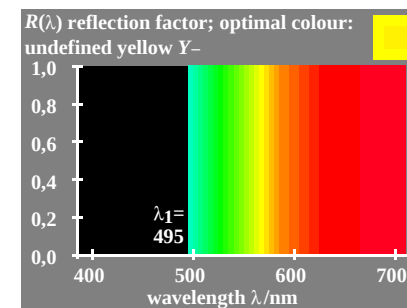
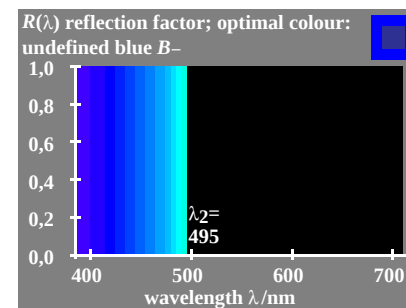
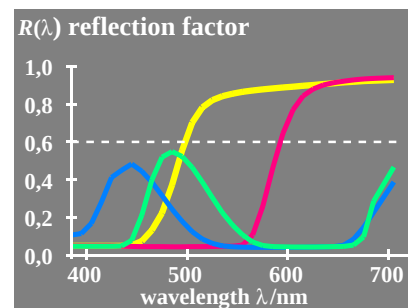


see similar files: <http://farbe.li.tu-berlin.de/ME54/ME54.HTM>
<http://130.149.60.45/~farbmeterik> or <http://farbe.li.tu-berlin.de>

TUB registration: 20190801-ME54/ME54L0NP.PDF /.PS
application for measurement of display output

TUB material: code=rha4ta

















input: *rgb/cmyk* -> *rgb/cmyk*
output: no change

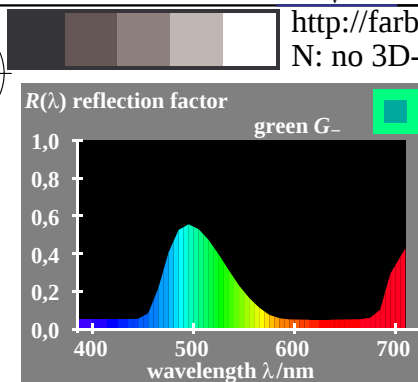

see similar files: <http://farbe.li.tu-berlin.de/ME54/ME54.HTM>
<http://130.149.60.45/~farbmeterik> or <http://farbe.li.tu-berlin.de>

TUB registration: 20190801-ME54/ME54L0NP.PDF /.PS
application for measurement of display output, no separation

















TUB material: code=rha4ta

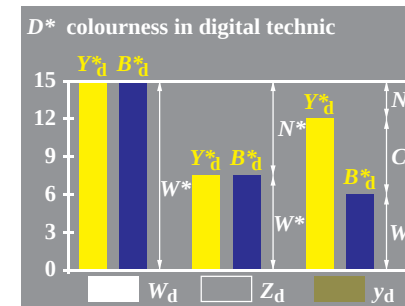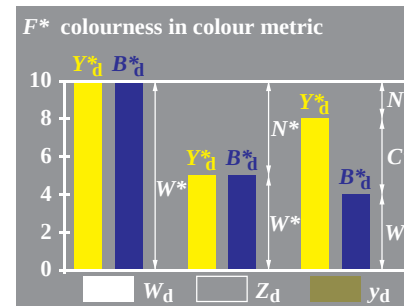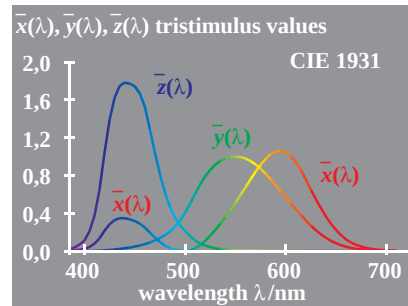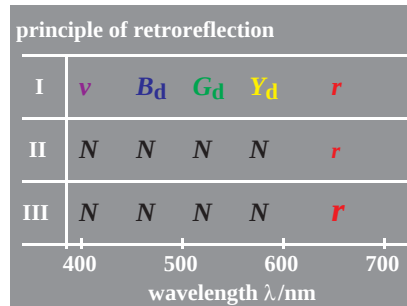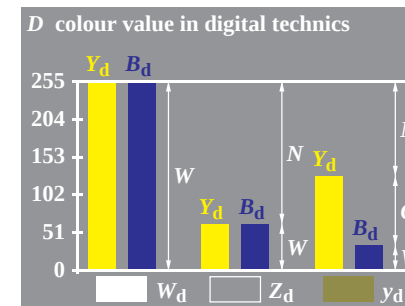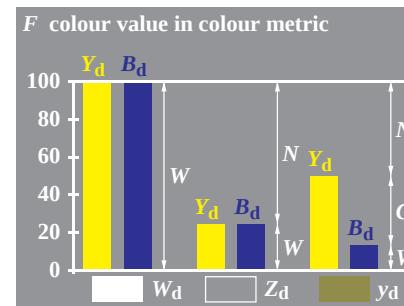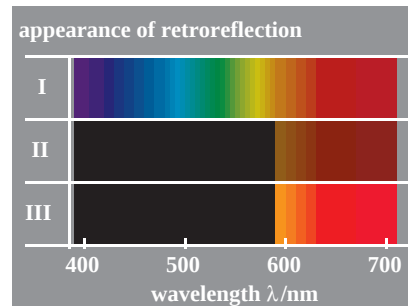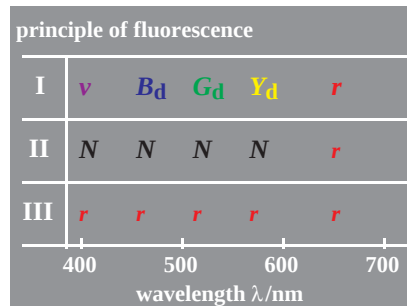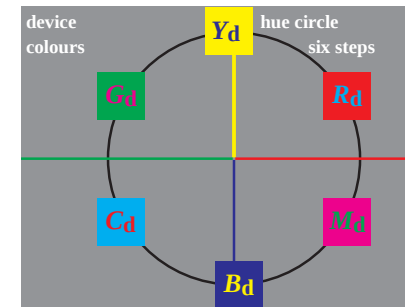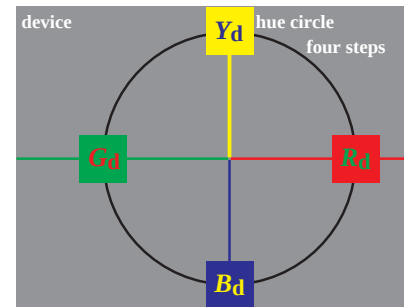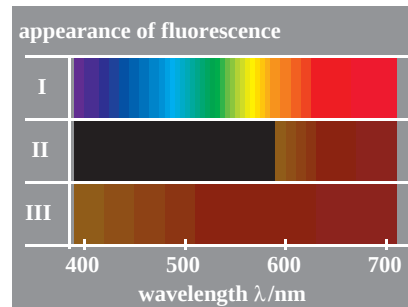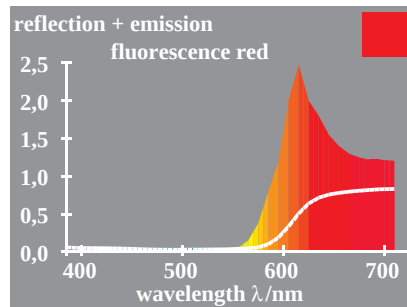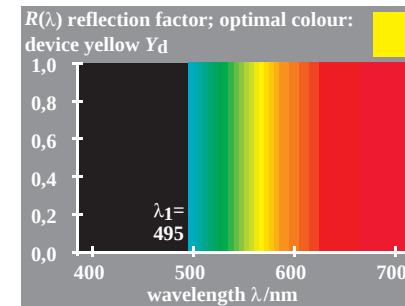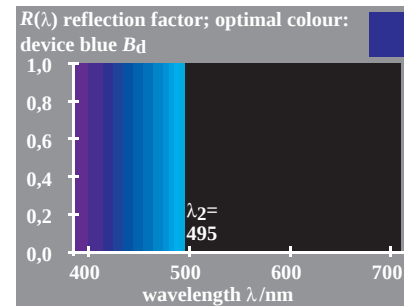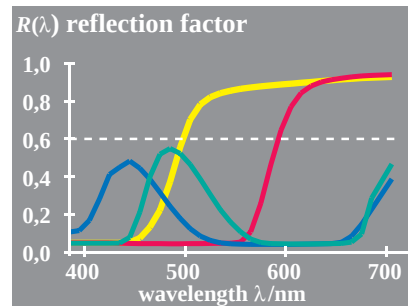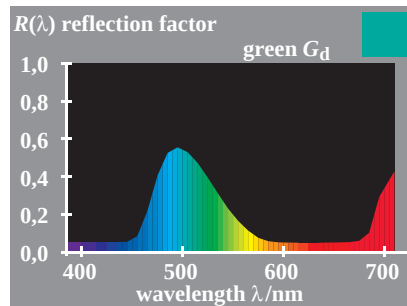

see similar files: <http://farbe.li.tu-berlin.de/ME54/ME54.HTM>
<http://130.149.60.45/~farbmeterik> or <http://farbe.li.tu-berlin.de>

TUB registration: 20190801-ME54/ME54L0NP.PDF /.PS
application for measurement of display output

TUB material: code=rha4ta

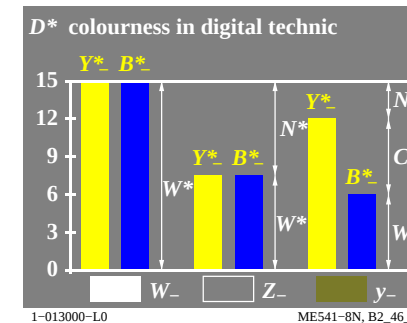
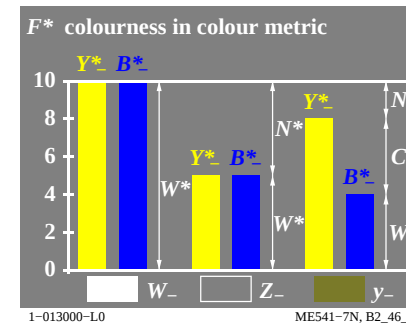
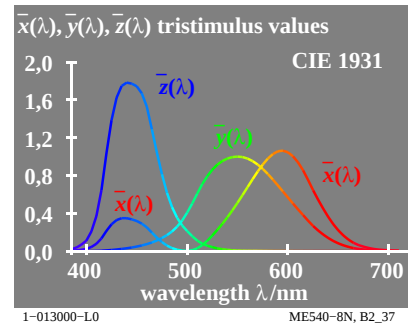
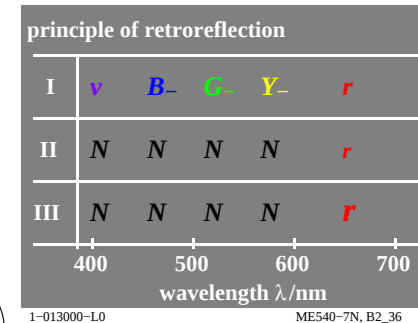
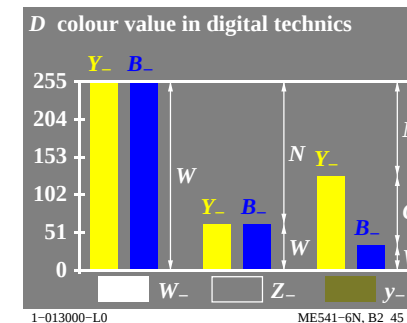
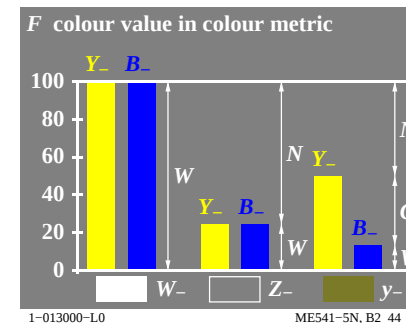
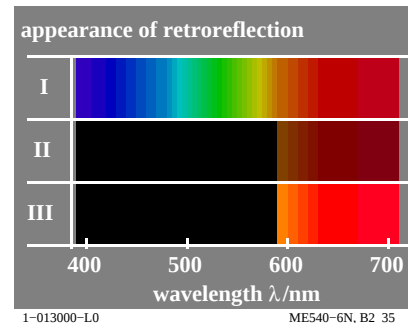
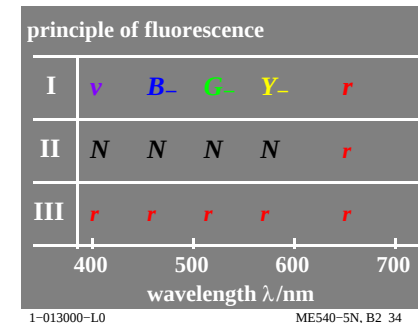
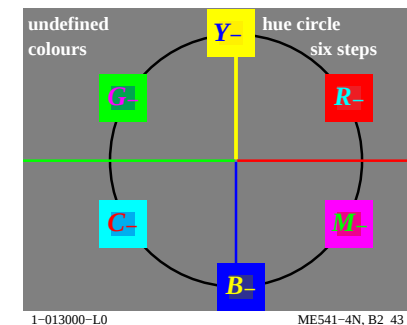
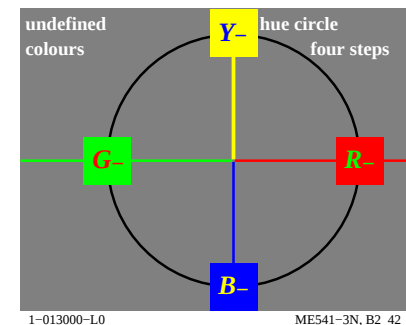
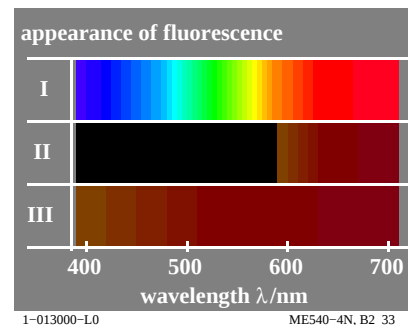
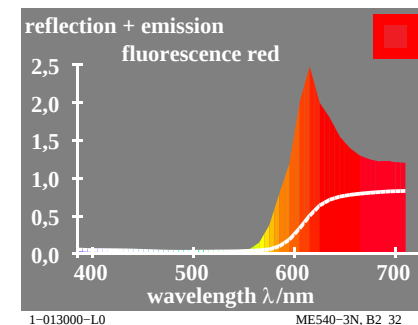
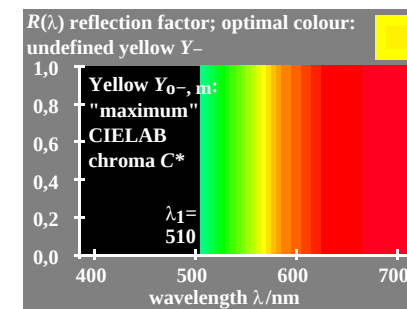
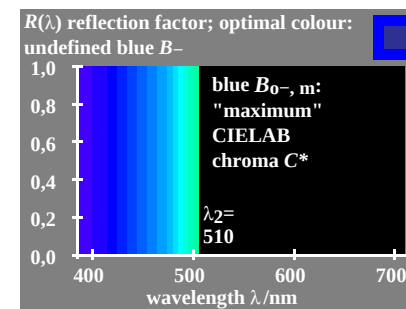
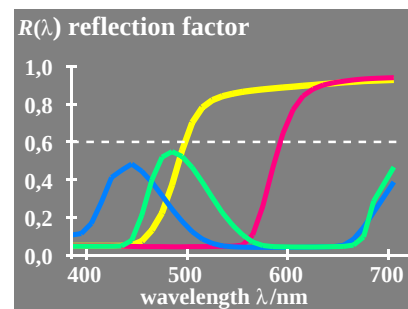
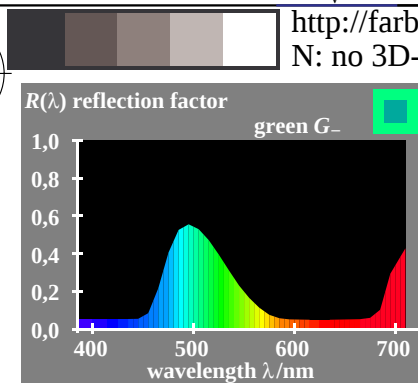


<http://farbe.li.tu-berlin.de/ME54/ME54L0NP.PDF> / .PS; transfer output
N: no 3D-linearization (OL) in file (F) or PS-startup (S), page 2/2

see similar files: <http://farbe.li.tu-berlin.de/ME54/ME54.HTM>
<http://130.149.60.45/~farbmeterik> or <http://farbe.li.tu-berlin.de>

TUB registration: 20190801-ME54/ME54L0NP.PDF / .PS
application for measurement of display output, no separation

TUB material: code=rha4ta

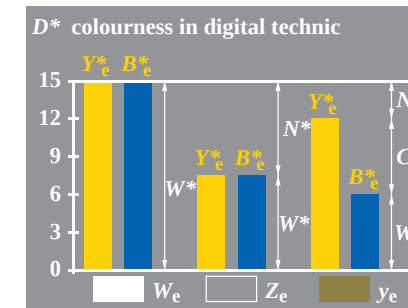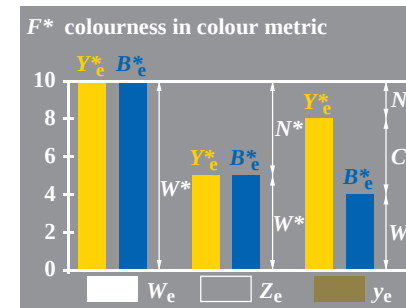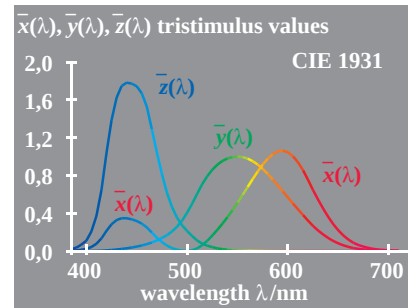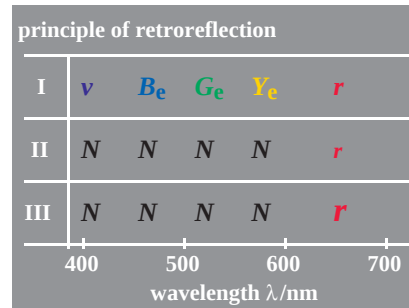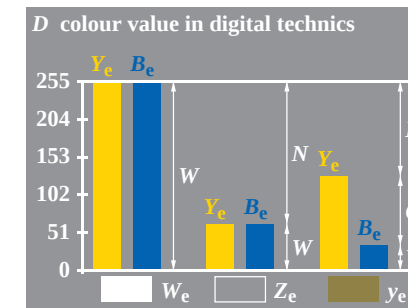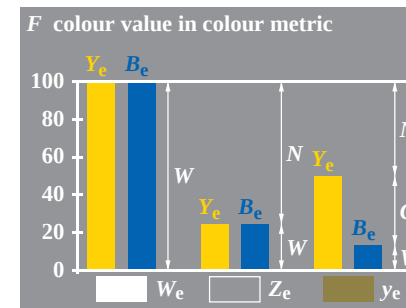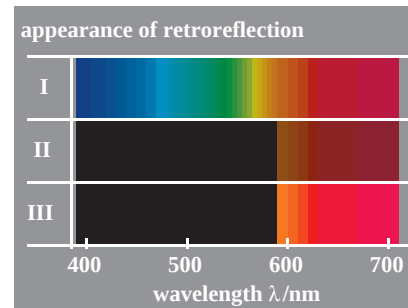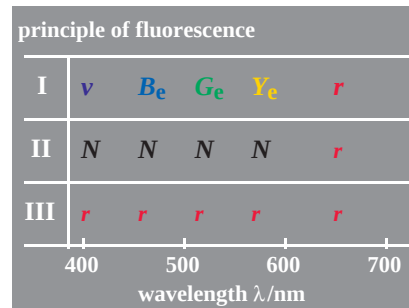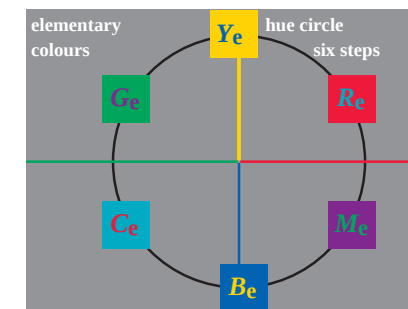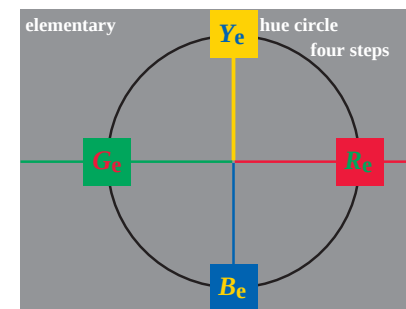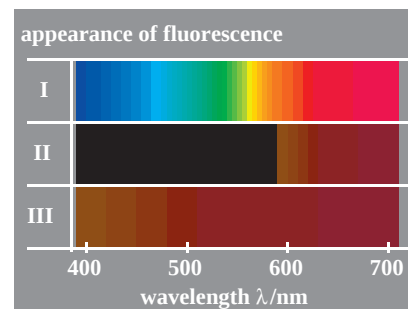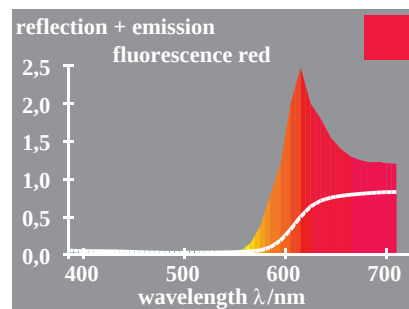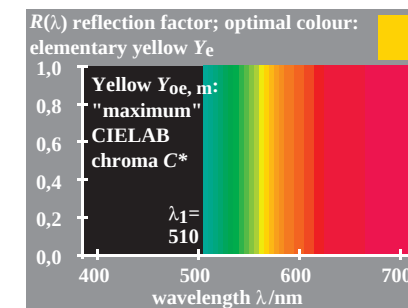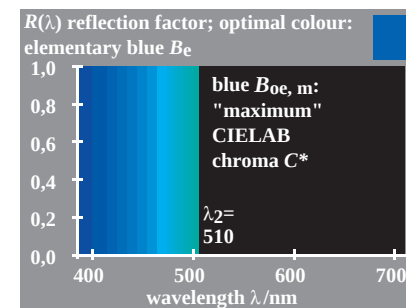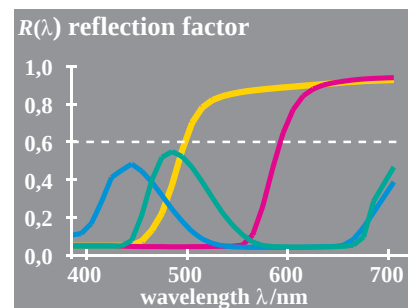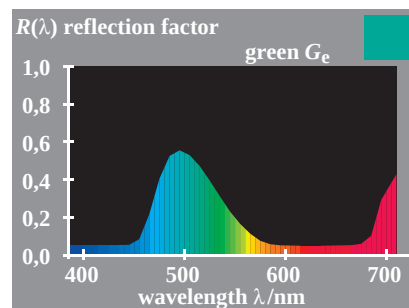

TUB-test chart ME54; Computer graphics and colorimetry
Image series ME54, 3D=0, de=1, L^*cmyn6

PE4300L_120830.TXT, 1080 colors, Separation $cmyn6^*$
input: $rgb/cmyk \rightarrow rgb_e$
output: transfer to rgb_e

