
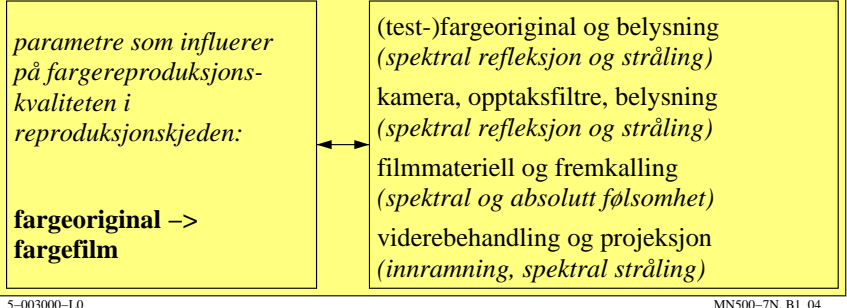
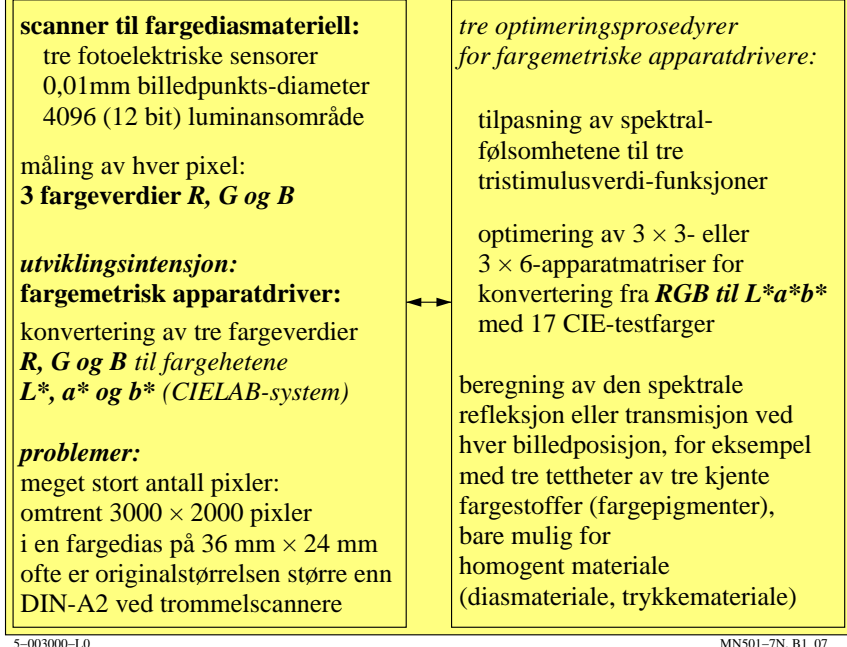
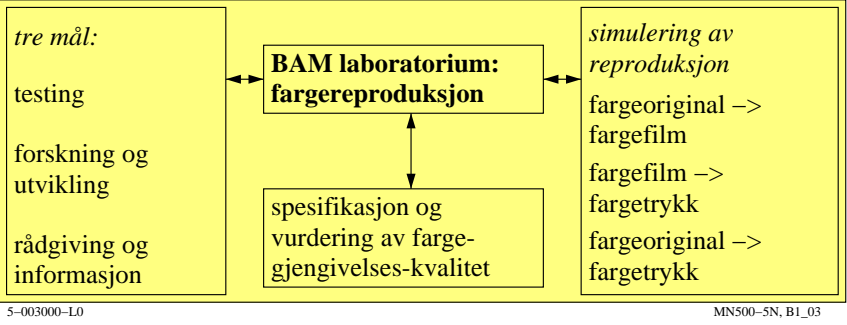
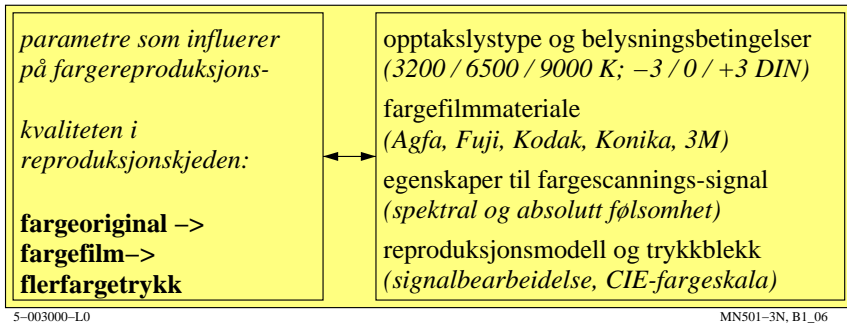
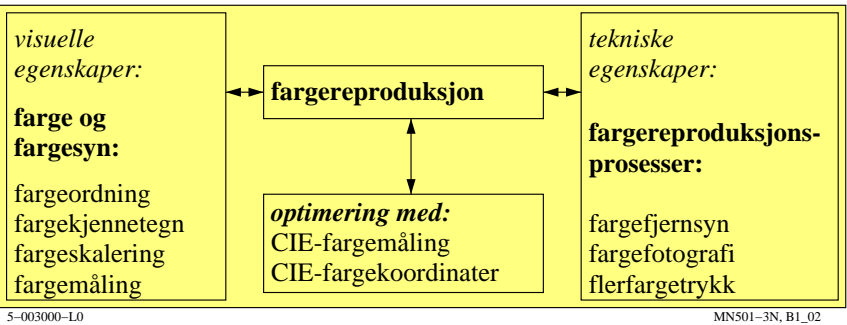
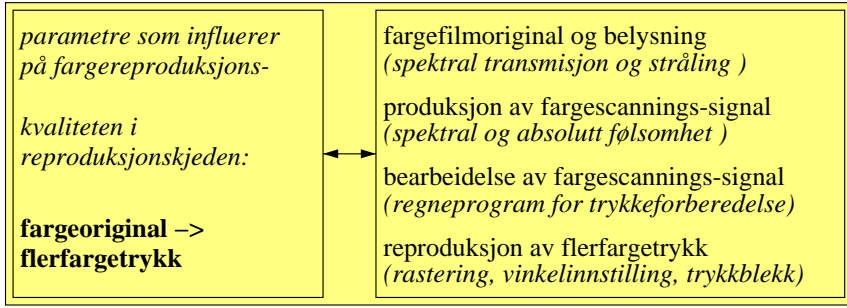


se lignende filer: <http://farbe.li.tu-berlin.de/MN50/MN50.HTM>
<http://130.149.60.45/~farbmetrik> eller <http://farbe.li.tu-berlin.de>


TUB registrering: 20190801-MN50/MN50L0NA.TXT /.PS
anvendelse for måling av display output

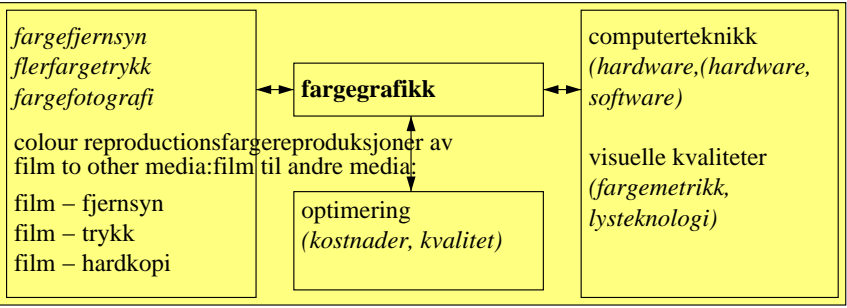

se lignende filer: <http://farbe.li.tu-berlin.de/MN50/MN50.HTM>
<http://130.149.60.45/~farbmetrik> eller <http://farbe.li.tu-berlin.de>


TUB registrering: 20190801-MN50/MN50L0NA.TXT /.PS
anvendelse for måling av display output, ingen separasjon

TUB materiell: code=rh4ta

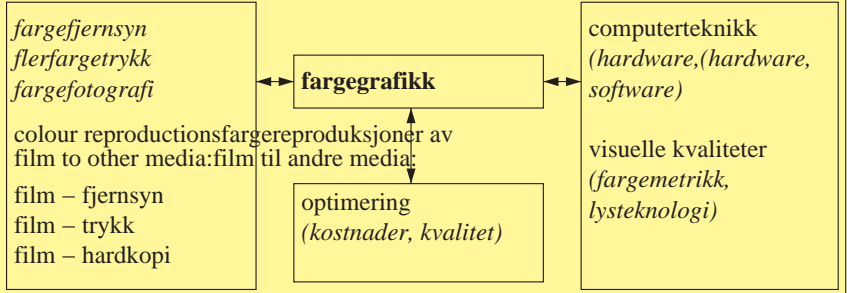


5-003100-L0

MN500-10, B1_01

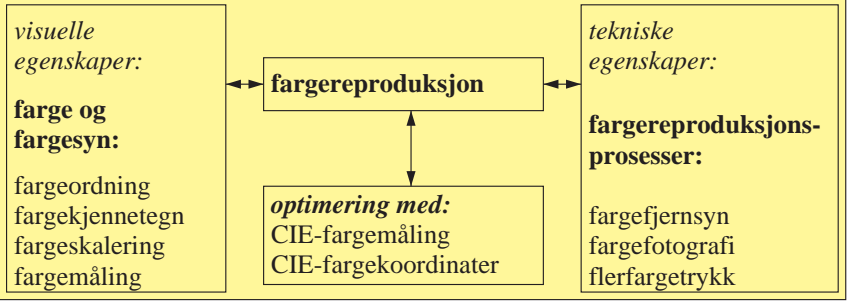


5-003100-L0

MN501-30, B1_02

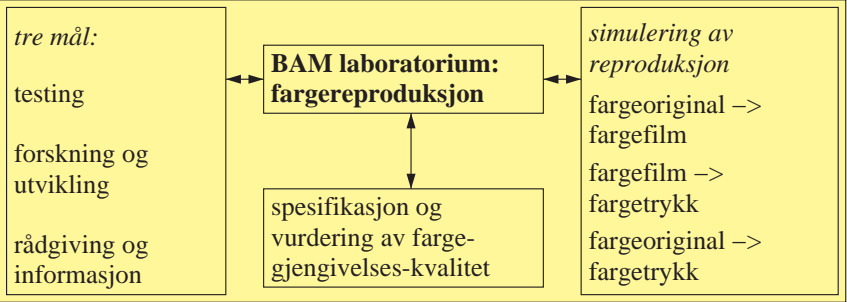


5-003100-L0

MN500-70, B1_03

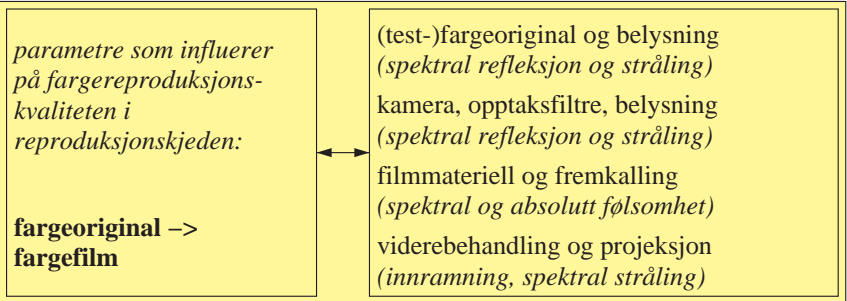


5-003100-L0

MN500-70, B1_04

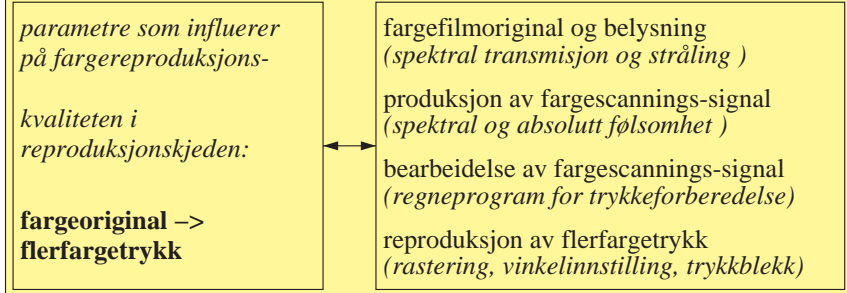


5-003100-L0

MN501-10, B1_05

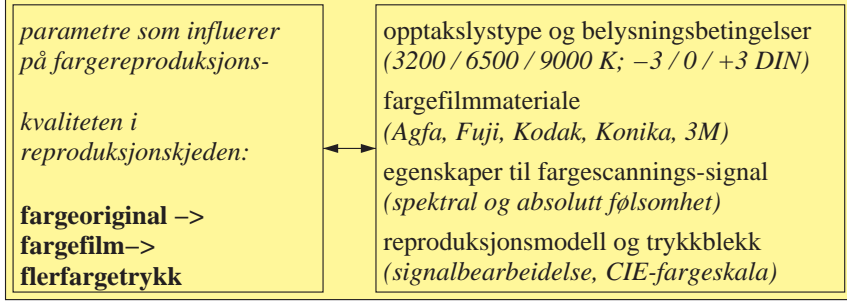

5-003100-L0

MN501-30, B1_06







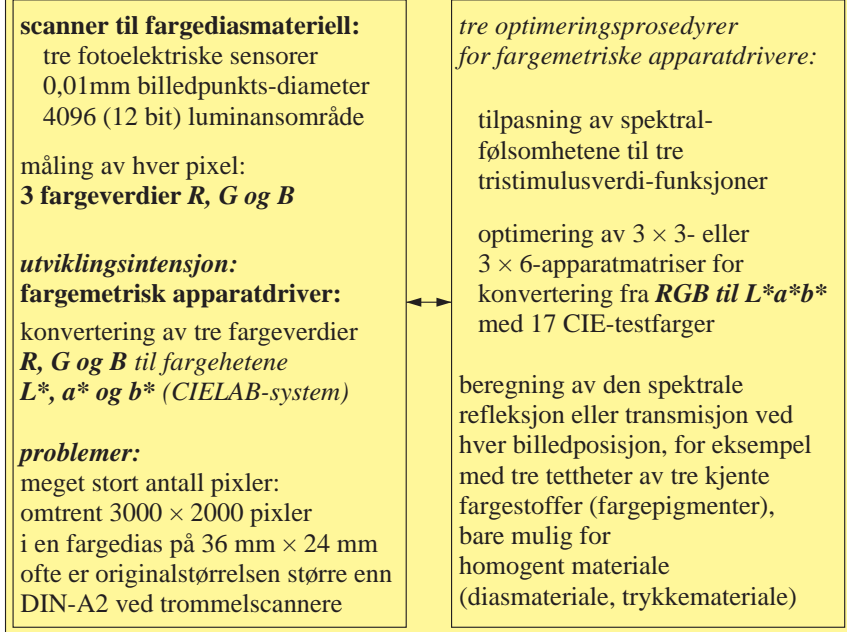


5-003100-L0

MN501-70, B1_07

se lignende filer: [http://130.149.60.45/~farbmetrik](http://farbe.li.tu-berlin.de/MN50/MN50.HTM) eller <http://farbe.li.tu-berlin.de>

TUB registrering: 20190801-MN50/MN50L0NA.TXT /.PS
anvendelse for måling av display output

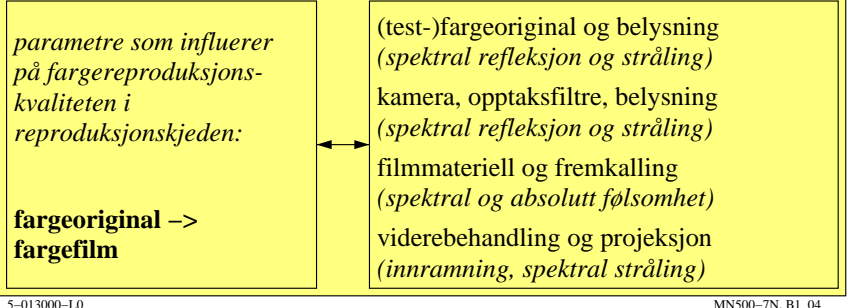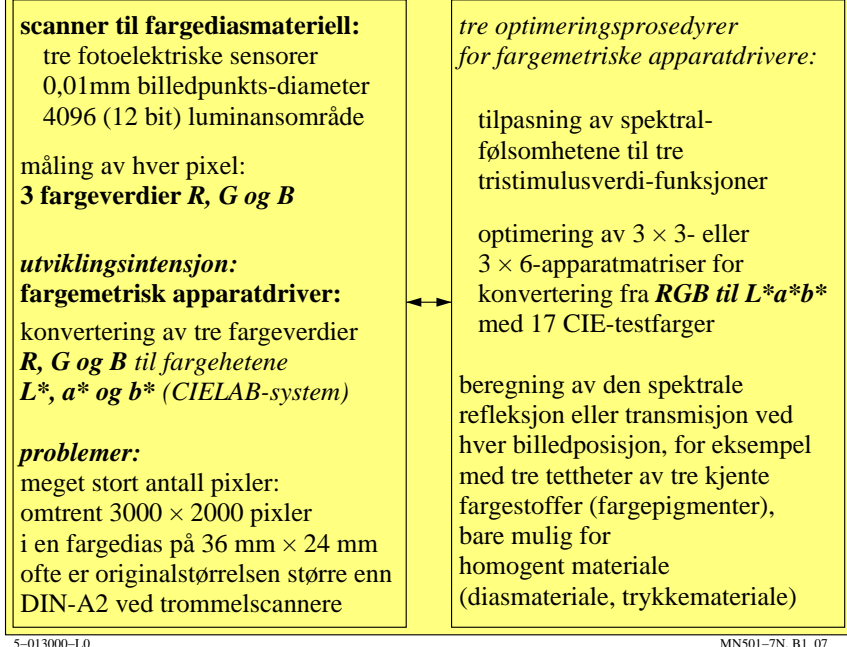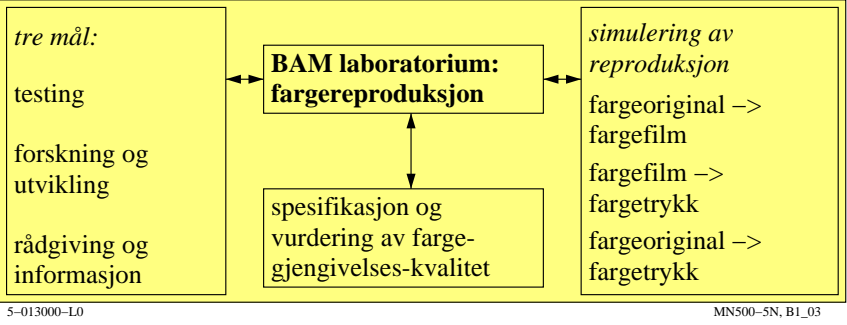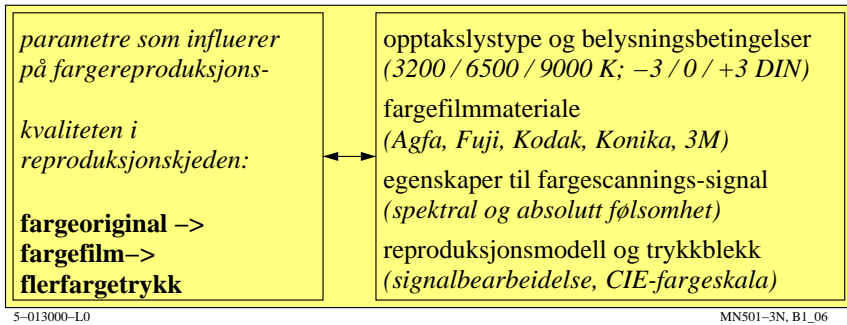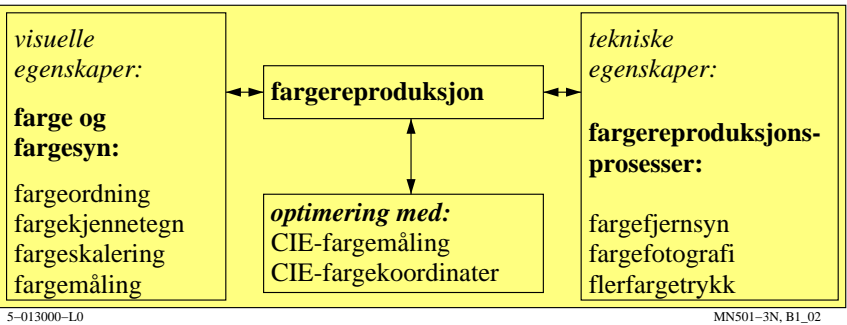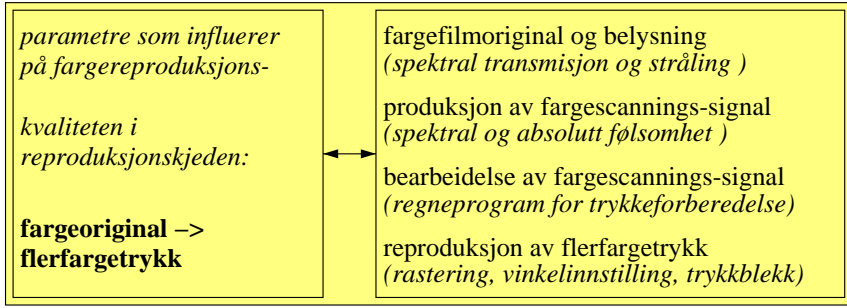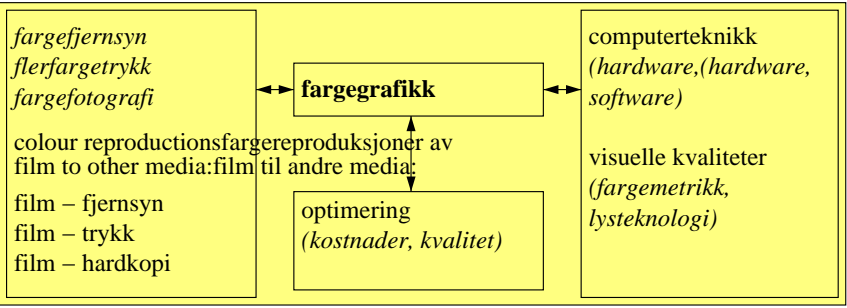

se lignende filer: <http://farbe.li.tu-berlin.de/MN50/MN50.HTM>
<http://130.149.60.45/~farbmetrik> eller <http://farbe.li.tu-berlin.de>

TUB registrering: 20190801-MN50/MN50L0NA.TXT /.PS
anvendelse for måling av display output, ingen separasjon

TUB materiell: code=rh4ta

