

http://130.149.60.45/~farbmetrik/LE74/LE74L0NA.TXT /.PS; start output
N: No Output Linearization (OL) data in File (F), Startup (S) or Device (D)

TUB-test chart LE74; Colorimetric system G, Page 1/1

40x27=1080 colours for Measurement: *rgb/000n/w/nnn0/www*

input: *rgb/000n/w/nnn0/www*

output: no change compared to input

TUB registration: 20110301-LE74/LE74L0NA.TXT /.PS
application for measurement of printer or monitor systems


TUB material: code=rha4ta

See original or copy: <http://web.me.com/klaus.richter/LE74/LE74L0NA.TXT> /.PS
Technical information: <http://www.ps.bann.de> or <http://130.149.60.45/~farbmetrik>

LE740-7N, 1/3, Test chart G with 40x27=1080 colours; digital equidistant 9 or 16 step colour scales; Colour data in column (A-n): *rgb + cmy0 (A_j + k26_n27), 000n (k), w (l), nnn0 (m), www (n), colorm = 0, separation = A*

http://130.149.60.45/~farbmetrik/LE74/LE74L0NA.TXT /.PS; start output
N: No Output Linearization (OL) data in File (F), Startup (S) or Device (D)

See original or copy: <http://web.me.com/klaus.richter/LE74/LE74L0NA.TXT> /.PS
Technical information: <http://www.ps.bam.de> or <http://130.149.60.45/~farbmetrik>

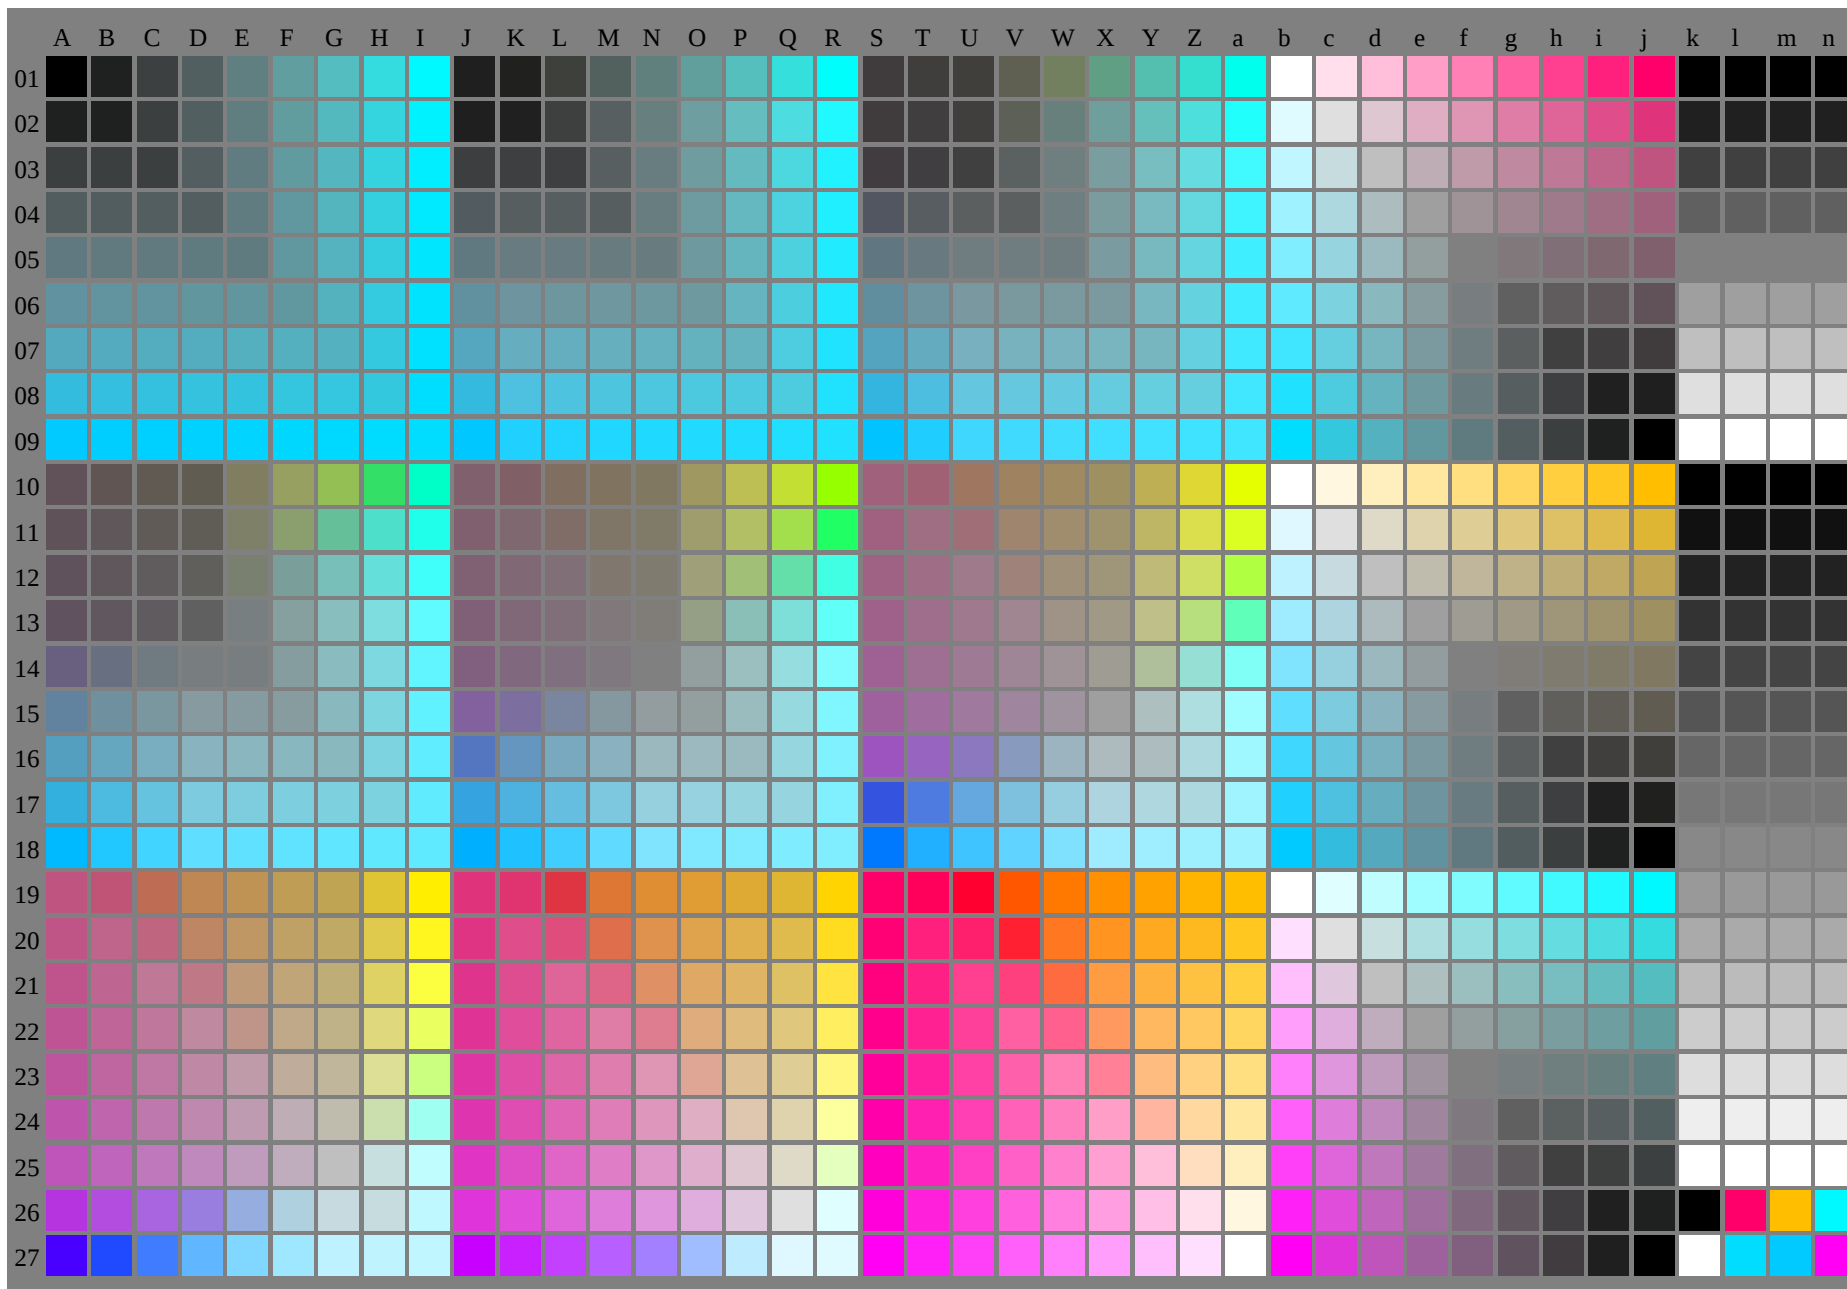

LE740-7N, 1/3, Test chart G with 40x27=1080 colours; digital equidistant 9 or 16 step colour scales; Colour data in column (A-n): rgb^* (A_n), $colorm = 1$, $separation = A$, $cmy0^*$

TUB-test chart LE74; Colorimetric system G, Page 1/1

40x27=1080 colours for Measurement: $rgb/000n/w/nnn0/www$

input: $rgb/000n/w/nnn0/www$

output: no change compared to input

TUB registration: 20110301-LE74/LE74L0NA.TXT /.PS
application for measurement of printer or monitor systems

TUB material: code=rha4ta