

| i  | LAB*ref | l*out | LAB*out | LAB*out/c-ref | ΔE*  |
|----|---------|-------|---------|---------------|------|
| 1  | 0.0     | 0.0   | 0.0     | 0.0           | 0.01 |
| 2  | 6.36    | 0.0   | 0.07    | 6.36          | 0.01 |
| 3  | 12.72   | 0.0   | 0.13    | 12.72         | 0.01 |
| 4  | 19.08   | 0.0   | 0.2     | 19.08         | 0.01 |
| 5  | 25.44   | 0.0   | 0.27    | 25.44         | 0.01 |
| 6  | 31.8    | 0.0   | 0.33    | 31.8          | 0.01 |
| 7  | 38.16   | 0.0   | 0.4     | 38.16         | 0.01 |
| 8  | 44.52   | 0.0   | 0.47    | 44.52         | 0.01 |
| 9  | 50.89   | 0.0   | 0.53    | 50.89         | 0.01 |
| 10 | 57.25   | 0.0   | 0.6     | 57.25         | 0.01 |
| 11 | 63.61   | 0.0   | 0.67    | 63.61         | 0.01 |
| 12 | 69.97   | 0.0   | 0.73    | 69.97         | 0.01 |
| 13 | 76.33   | 0.0   | 0.8     | 76.33         | 0.01 |
| 14 | 82.69   | 0.0   | 0.87    | 82.69         | 0.01 |
| 15 | 89.05   | 0.0   | 0.93    | 89.05         | 0.01 |
| 16 | 95.41   | 0.0   | 1.0     | 95.41         | 0.01 |
| 17 | 0.0     | 0.0   | 0.0     | 0.0           | 0.01 |
| 18 | 23.85   | 0.0   | 0.25    | 23.85         | 0.01 |
| 19 | 47.71   | 0.0   | 0.5     | 47.71         | 0.01 |
| 20 | 71.56   | 0.0   | 0.75    | 71.56         | 0.01 |
| 21 | 95.41   | 0.0   | 1.0     | 95.41         | 0.01 |


**Start-Ausgabe S1**  
**Kennzeichnung nach**  
**ISO/IEC 15775 Anhang G**  
**und DIN 33866-1 Anhang G**

Mittlerer Helligkeitsabstand (16 Stufen)  
 $\Delta E^*_{CIELAB} = 0.0$

Mittlerer Helligkeitsabstand (5 Stufen)  
 $\Delta L^*_{CIELAB} = 0.0$

Mittlerer Farbwiedergabe-Index:  $R^*_{ab,m} = 100$

OG890-3N-020-2: File: Measure unknown; Device: Device unknown; Date: Date unknown

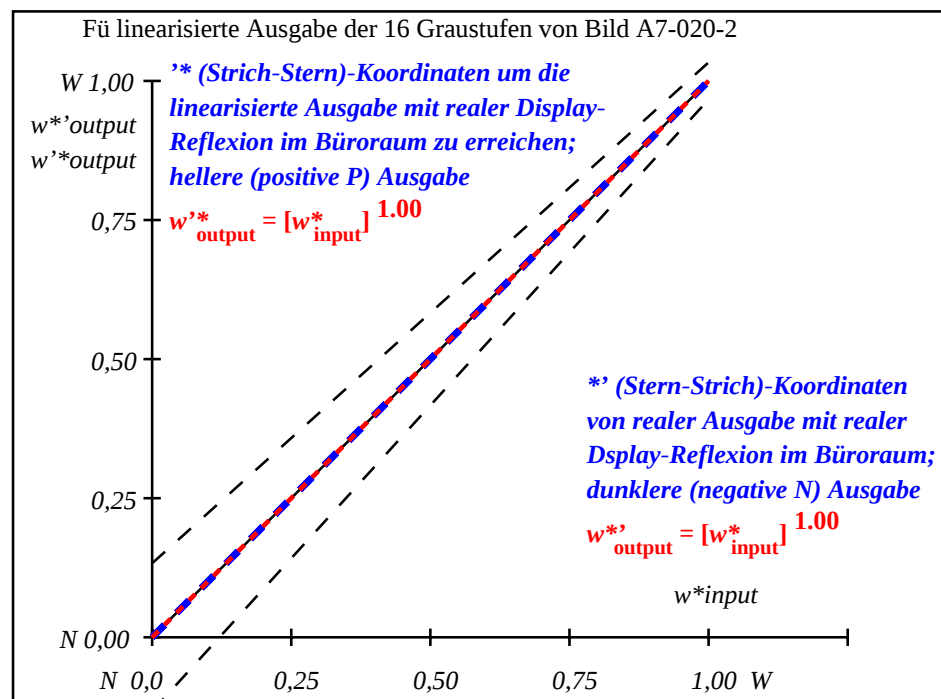

OG891-3N-020-2: File: Measure unknown; Device: Device unknown; Date: Date unknown

| $L^*/Y_{intended}$<br>(absolut)                                 | 0.0/0.0 | 6.4/0.7 | 12.7/1.5 | 19.1/2.8 | 25.4/4.6 | 31.8/7.0 | 38.2/10.2 | 44.5/14.2 | 50.9/19.2 | 57.2/25.2 | 63.6/32.3 | 70.0/40.7 | 76.3/50.4 | 82.7/61.6 | 89.0/74.3 | 95.4/88.6 |
|-----------------------------------------------------------------|---------|---------|----------|----------|----------|----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|-----------|
| $n^* n^* n^* 0$<br>setcmyk<br>$g_P=1.00$<br>Nr.-und<br>Hex-Code | 00;F    | 01;E    | 02;D     | 03;C     | 04;B     | 05;A     | 06;9      | 07;8      | 08;7      | 09;6      | 10;5      | 11;4      | 12;3      | 13;2      | 14;1      | 15;0      |
| $w^*=l^*$<br>$CIELAB, r$<br>(relativ)                           |         |         |          |          |          |          |           |           |           |           |           |           |           |           |           |           |
| $w^*_{intended}$                                                | 0,000   | 0,067   | 0,133    | 0,200    | 0,267    | 0,333    | 0,400     | 0,467     | 0,533     | 0,600     | 0,667     | 0,733     | 0,800     | 0,867     | 0,933     | 1,000     |
| $w^*_{out}$                                                     | 0.0     | 0.067   | 0.133    | 0.2      | 0.267    | 0.333    | 0.4       | 0.467     | 0.533     | 0.6       | 0.667     | 0.733     | 0.8       | 0.867     | 0.933     | 1.0       |

OG890-7N, Bild A7-020-2: 16 visuell gleichabständige  $L^*$ -Graustufen; PS-Operator:  $n^* n^* n^* 0$  setcmykcolor

OG89: Ein-Ausgabe-Beziehung nach ISO 9241-306; DH

Gesehener Y-Kontrast  $Y_W:Y_N=88,9:0,31$ ;  $Y_N$ -Bereich 0,0 to <0,46Ausgabe 020-2: keine Änderung

Eingabe:  $cmy0 (->cmy0^*_d)$  setcmyk