

Tavola 3 di campioni di colore per la resa del colore: colori matamerici sotto illuminanti A e P4000; stampa offset (CMY0); rgb

Serie:
metameric
m
A

intermedia
z
A/P4000

metameric
m
P4000

metameric
m
A





grigi
g
A/P4000

metameric
m
P4000

Lab*N0=17.8, 1.3, 0.7
Lab*W0=95.3, 0.3, -4.9
Lab*N=23.1, -3.5, -9.1
Lab*W=95.4, 0.3, -5.0

Lab*N0=17.8, 1.3, 0.7
Lab*W0=95.3, 0.3, -4.9
Lab*N1=17.7, 1.0, 0.7
Lab*W1=95.3, 0.6, -5.0
Lab*N=23.7, -5.0, -8.0
Lab*W=95.5, 0.6, -5.1

Lab*N1=17.7, 1.0, 0.7
Lab*W1=95.3, 0.6, -5.0
Lab*N=23.7, -5.0, -8.0
Lab*W=95.5, 0.6, -5.1

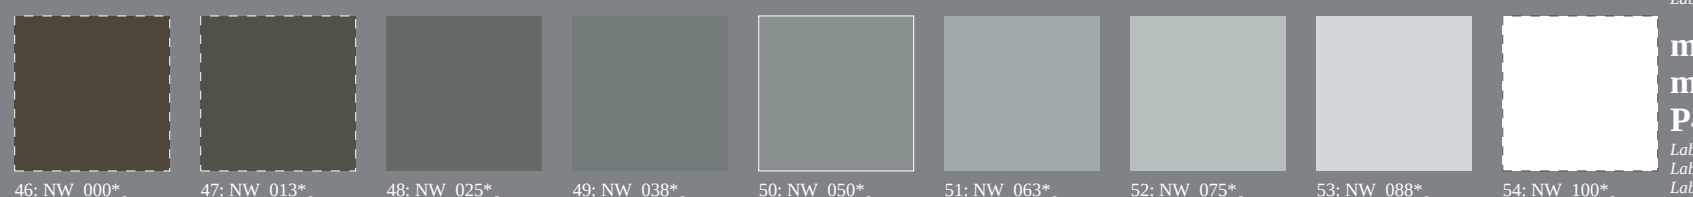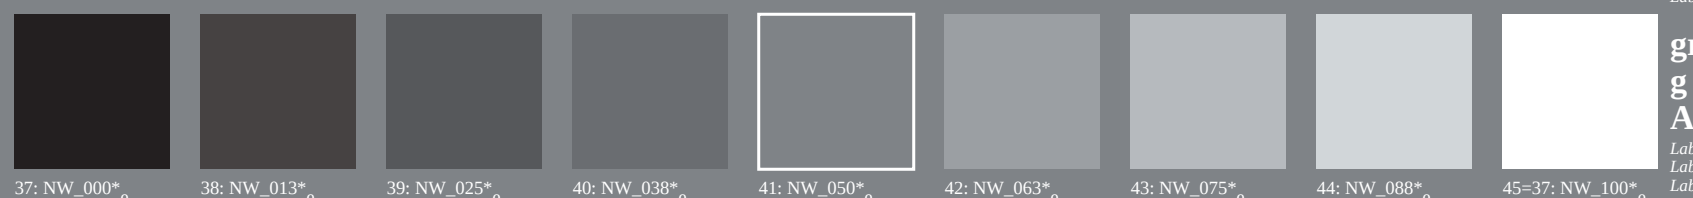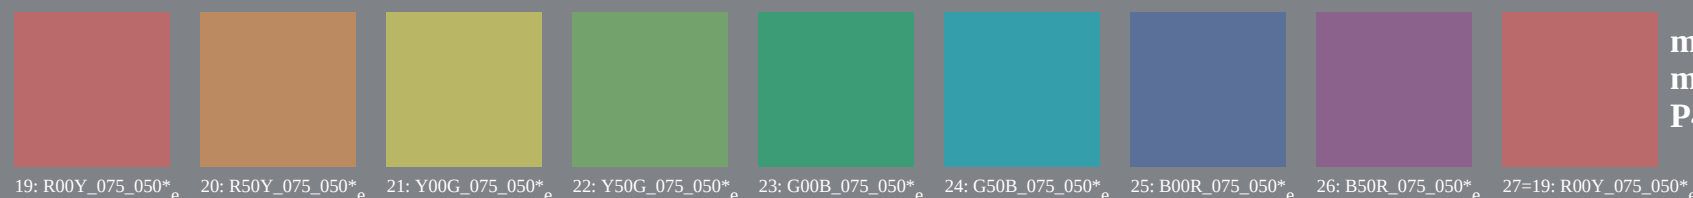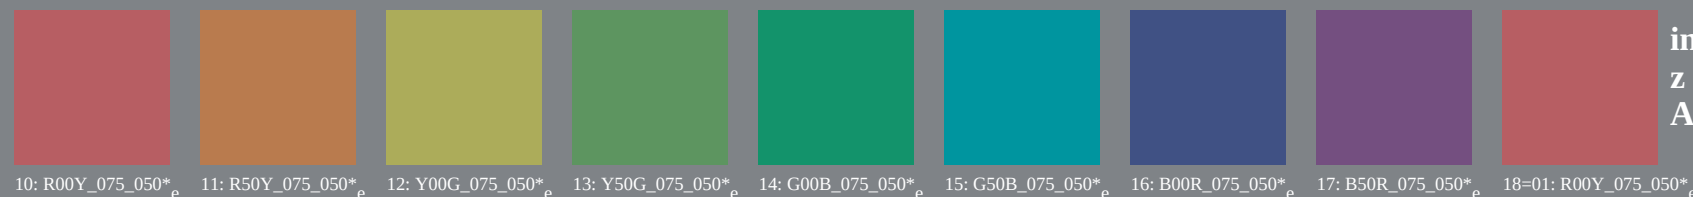

4-113130-L0 PI360-73

Grafico TUB-PI36; riproduzione del colore
54 colori; metamerica per A&P4000, 3D=1, de=1, cmy0*

Input: rgb/cmyk -> rgb_{de}
Output: 3D-linearizzazione a cmy0*_{de}

vedi file simili: <http://farbe.li.tu-berlin.de/PI36/PI36.HTM>
informazioni tecniche: <http://www.ps.bam.de> o <http://130.149.60.45/~farbmeterik>

iscrizione TUB: 20160501-PI36/PI36L0FP.PDF /.PS
Applicazione per la misura dell'output nella stampa di offset, separazione cmy0* (CMYK)

TUB materiale: code=rha4ta