


<http://130.149.60.45/~farbmetrik/SE16/SE16L0NP.PDF> /PS; transfer output

N: no 3D-linearization (OL) in file (F) or PS-startup (S), page 2/2

see similar files: <http://130.149.60.45/~farbmetrik/SE16/SE16.HTM>
technical information: <http://www.ps.bam.de> or <http://130.149.60.45/~farbmetrik>

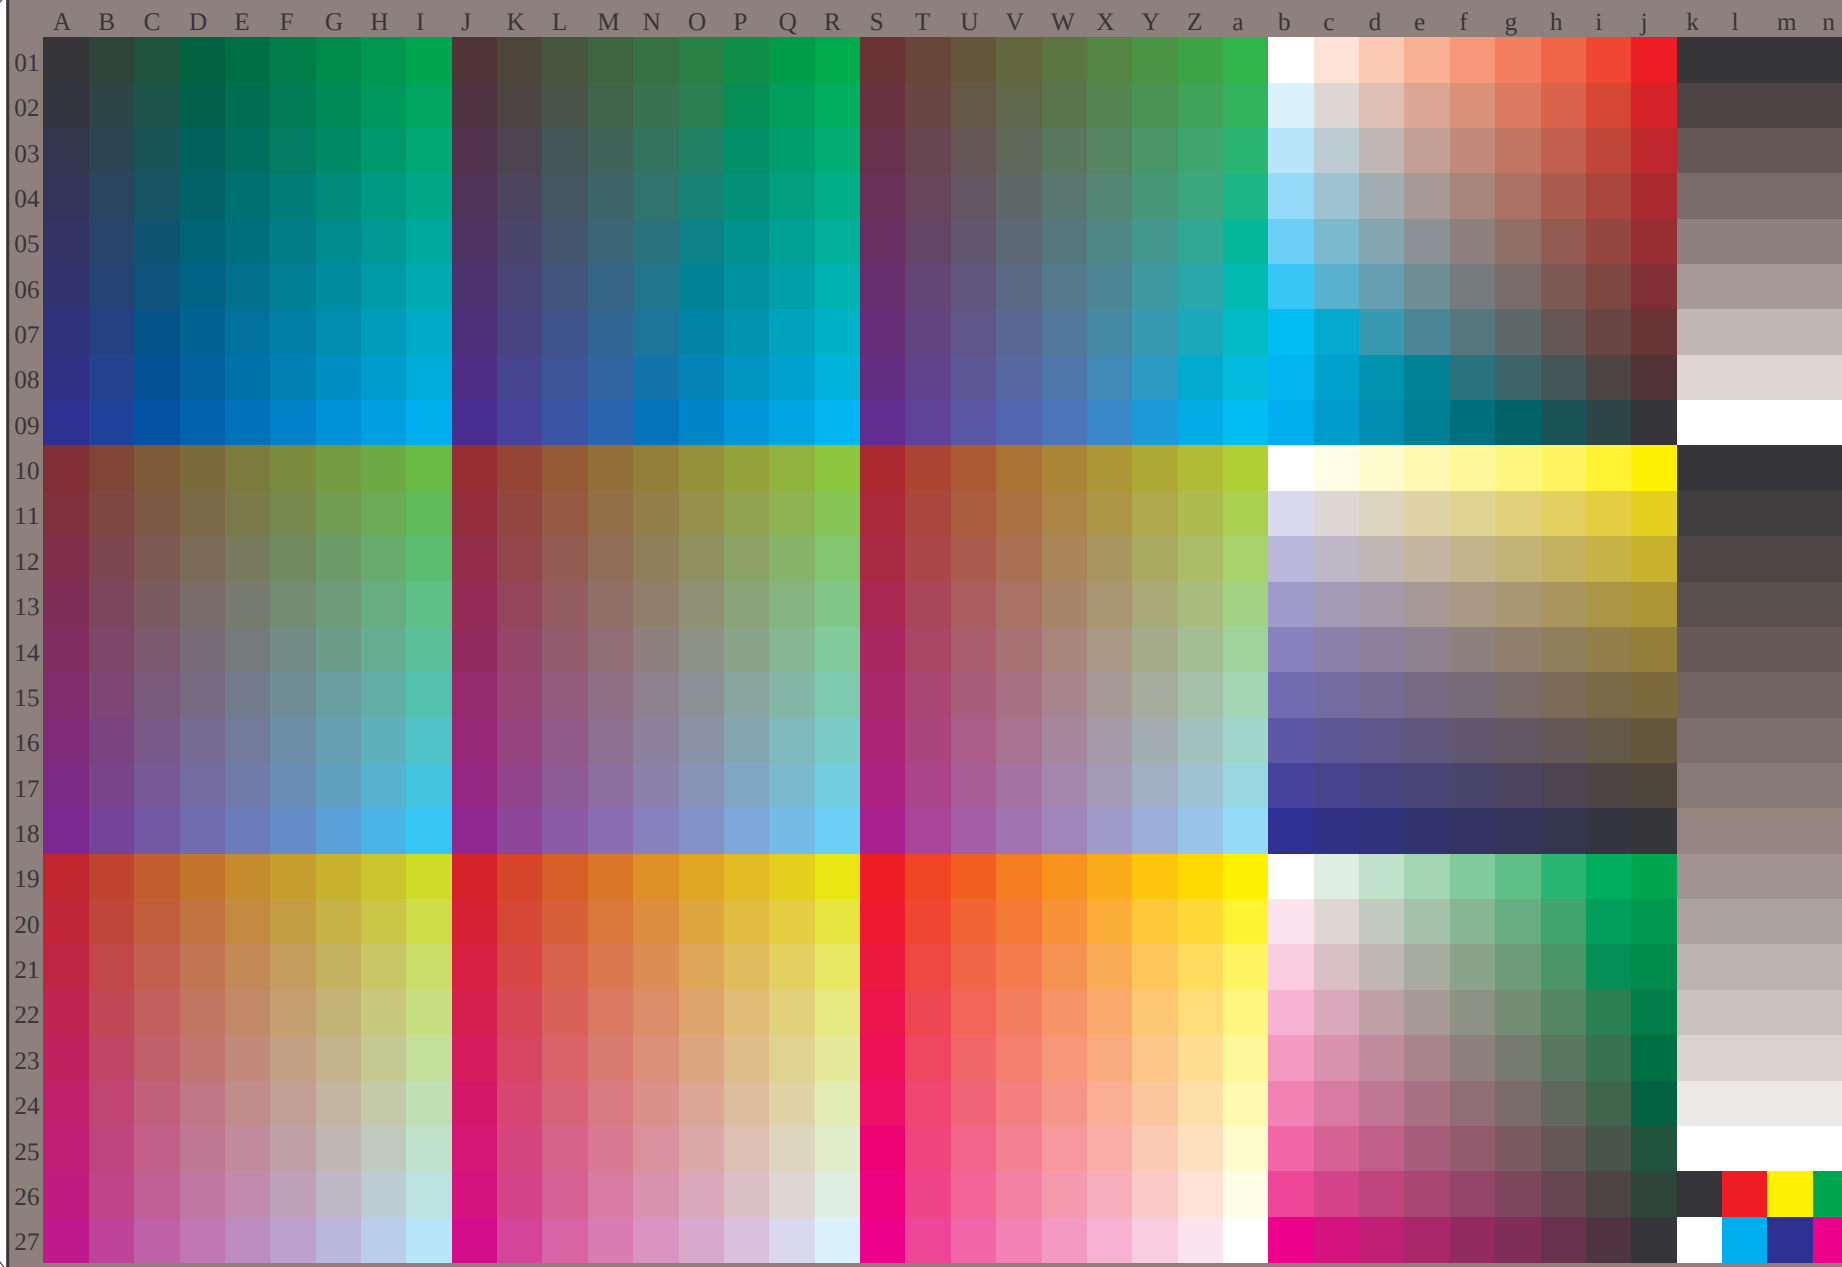

TUB registration: 20130201-SE16/SE16L0NP.PDF /PS
application for measurement of offset print output, separationcmY0 (CMY0)

TUB material: code=rha4ta

1-003131-L0

SE160-70

Test chart G with 40x27=1080 colours; digital equidistant 9 or 16 step colour scales; Colour data in column (A-n): $rgb(A_n)$, $3D=0$

TUB-test chart SE16; 1080 colours, offset standard paper

Test chart according to DIN 33872, $3D=0$, $de=0$, $cmY0$

input: $rgb/cmyk \rightarrow rgb_d$

output: transfer to $cmY0_d$

1-003131-F0