




Test chart 2 for color rendering: metameric colours D65 and D50; offset print (CMYK)

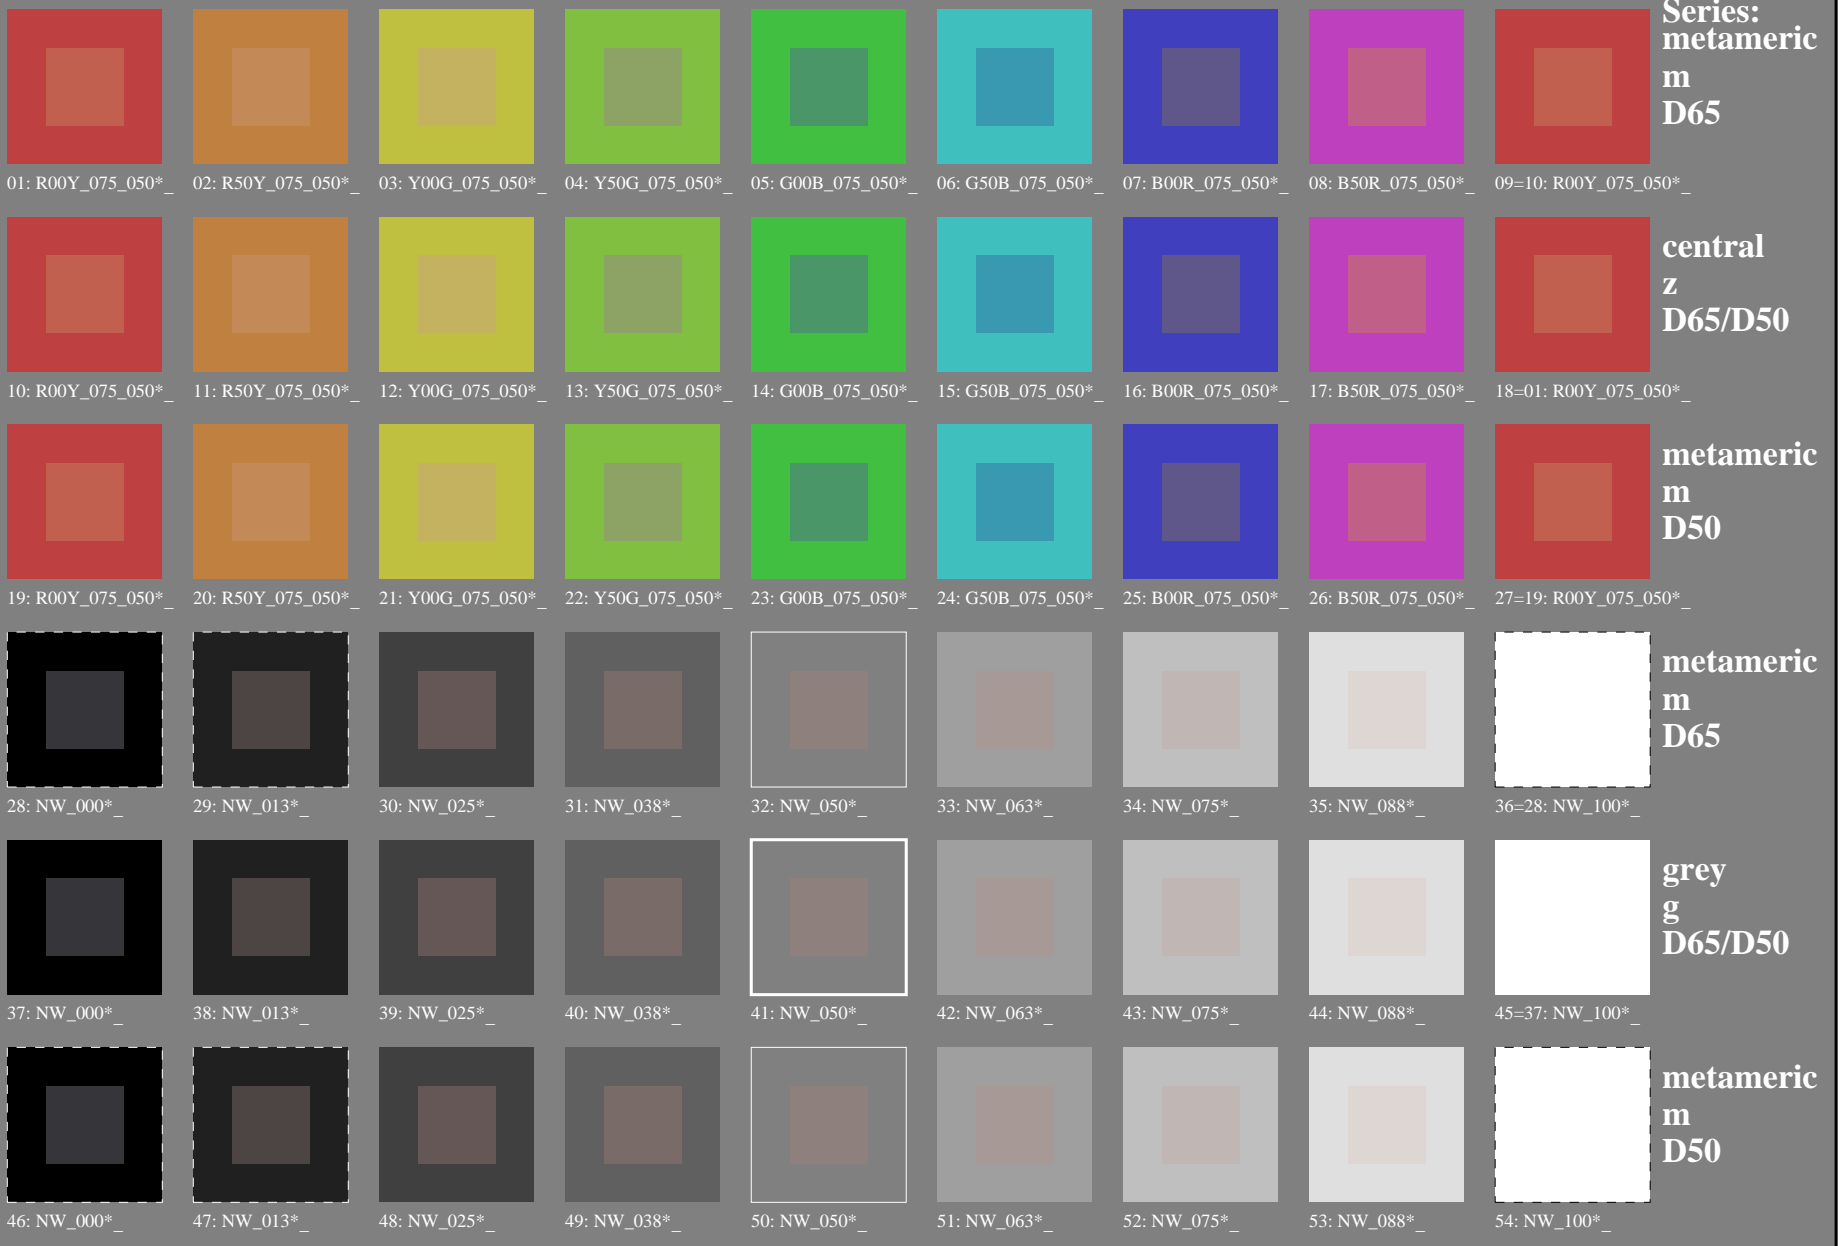

see similar files: <http://130.149.60.45/~farbmetrik/PE23/PE23LOFA.TXT /.PS>; start output
technical information: <http://www.ps.bam.de> or <http://130.149.60.45/~farbmetrik>

TUB registration: 20130201-PE23/PE23LOFA.TXT /.PS
application for measurement of offset print output

TUB material: code=rh4ta



Test chart 2 for color rendering: metameric colours D65 and D50; offset print (CMYK); rgb->rgb_{dd}

see similar files: <http://130.149.60.45/~farbmetrik/PE23/PE23.HTM>
technical information: <http://www.ps.bam.de> or <http://130.149.60.45/~farbmetrik>

TUB registration: 20130201-PE23/PE23L0FA.TXT /.PS
application for measurement of offset print output, separation cmyk* (CMYK)
TUB material: code=rh4ta



Series: metameric m D65

central Z D65/D50


metameric m D50

metameric m D65
 Lab*N0=17.7, 0.6, 0.6
 Lab*W0=95.4, 1.3, -4.9
 Lab*N=24.3, -5.6, -6.8
 Lab*W=95.6, 1.4, -5.0

grey g D65/D50
 Lab*N0=17.7, 0.6, 0.6
 Lab*W0=95.4, 1.3, -4.9
 Lab*N1=17.7, 0.8, 0.6
 Lab*W1=95.4, 0.8, -4.9

metameric m D50
 Lab*N1=17.7, 0.8, 0.6
 Lab*W1=95.4, 0.8, -4.9
 Lab*N=24.0, -5.6, -7.3
 Lab*W=95.5, 0.9, -5.0


Test chart 2 for color rendering: metameric colours D65 and D50; offset print (CMYK)

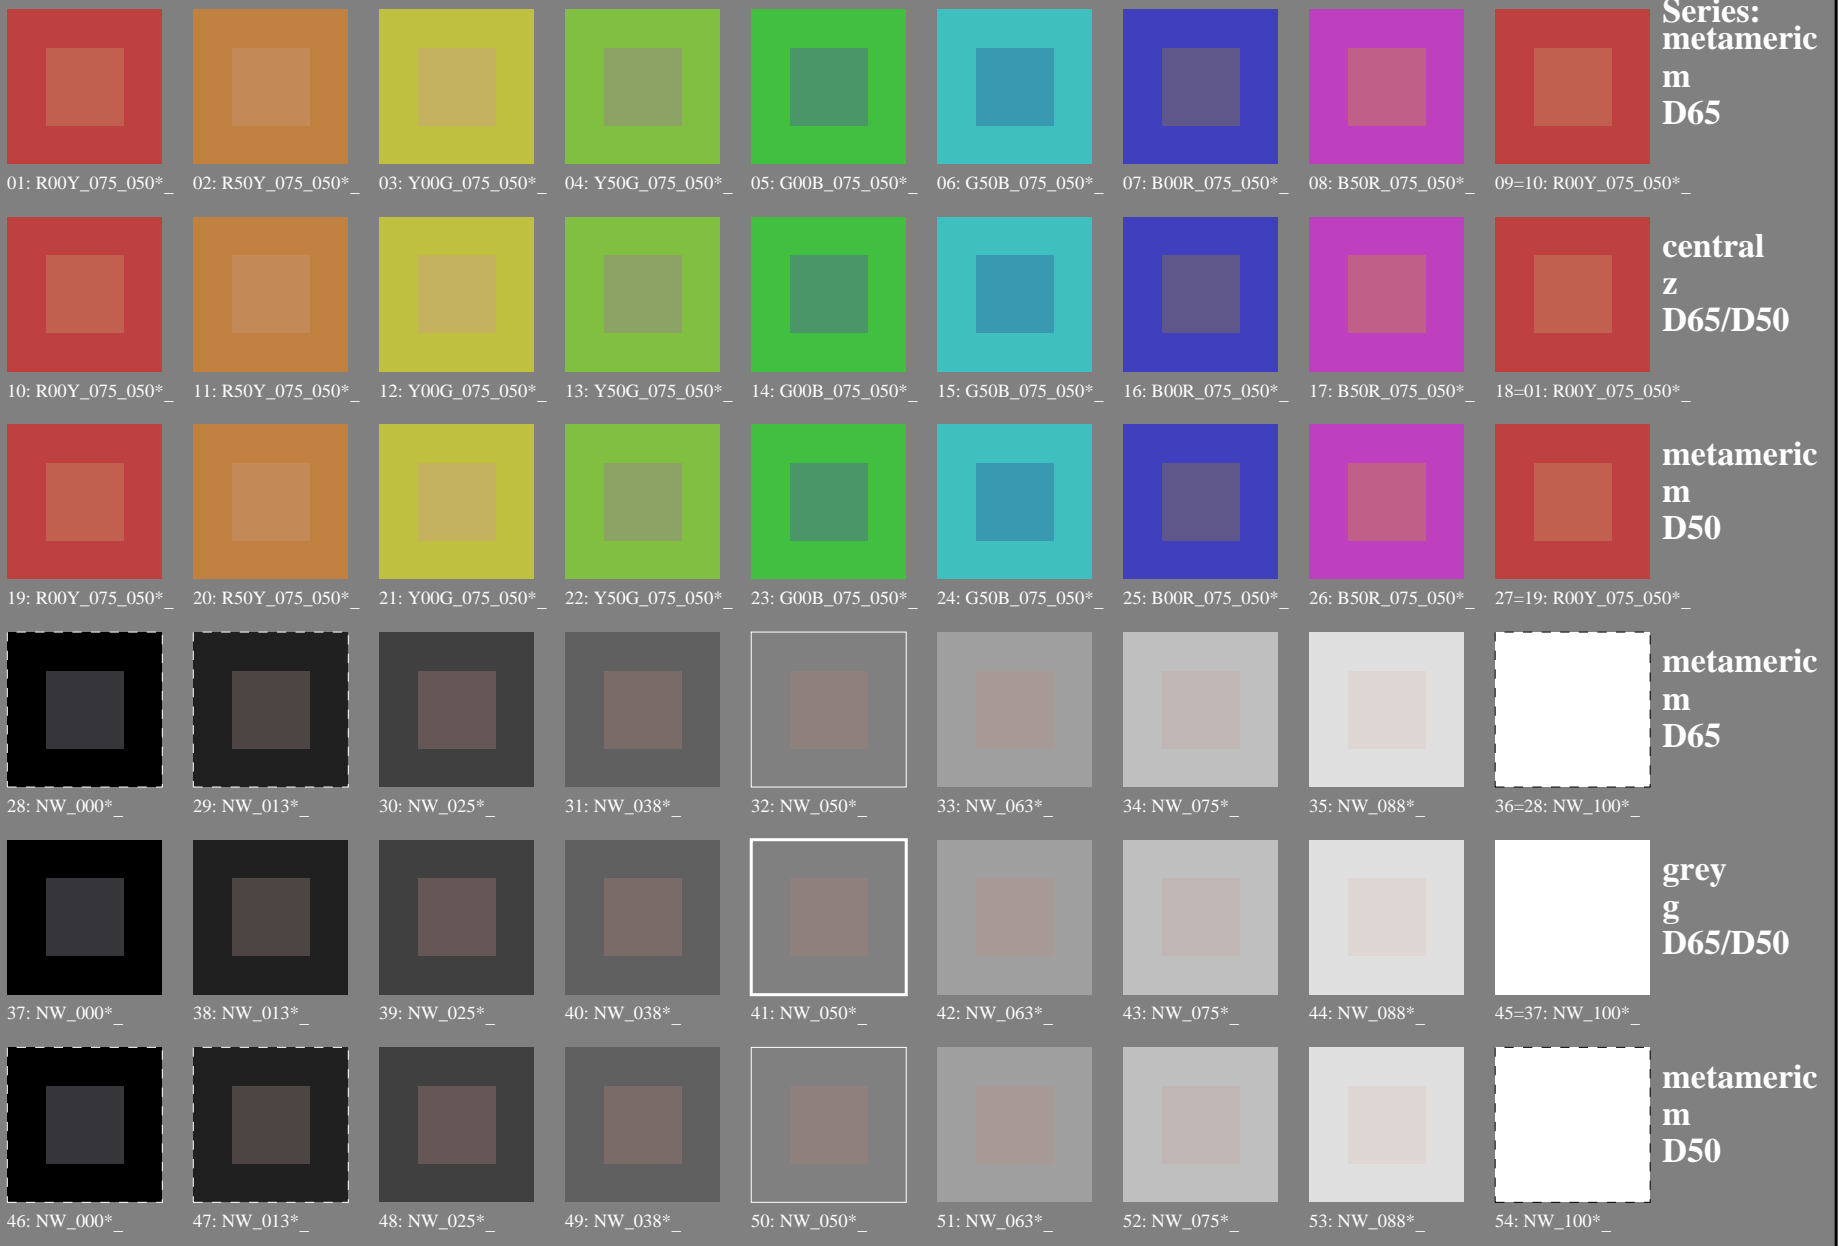

see similar files: <http://130.149.60.45/~farbmetrik/PE23/PE23LOFA.TXT /.PS>; start output
technical information: <http://www.ps.bam.de> or <http://130.149.60.45/~farbmetrik>

TUB registration: 20130201-PE23/PE23LOFA.TXT /.PS
application for measurement of offset print output

TUB material: code=rh4ta



Test chart 2 for color rendering: metameric colours D65 and D50; offset print (CMYK); rgb->rgbde



Series:
metameric
m
D65

central
z
D65/D50

metameric
m
D50

metameric
m
D65

grey
g
D65/D50

metameric
m
D50

Lab*N0=17.7, 0.6, 0.6
Lab*W0=95.4, 1.3, -4.9
Lab*N=24.3, -5.6, -6.8
Lab*W=95.6, 1.4, -5.0

Lab*N0=17.7, 0.6, 0.6
Lab*W0=95.4, 1.3, -4.9
Lab*N1=17.7, 0.8, 0.6
Lab*W1=95.4, 0.8, -4.9

Lab*N1=17.7, 0.8, 0.6
Lab*W1=95.4, 0.8, -4.9
Lab*N=24.0, -5.6, -7.3
Lab*W=95.5, 0.9, -5.0

see similar files: <http://130.149.60.45/~farbmetrik/PE23/PE23.HTM>
technical information: <http://www.ps.bam.de> or <http://130.149.60.45/~farbmetrik>

TUB registration: 20130201-PE23/PE23L0FA.TXT /.PS
application for measurement of offset print output, separation cmyk* (CMYK)
TUB material: code=rh4ta